














Notes

All structure designed to be fire protected for 60 minutes.


Fire alarm system to be designed by services engineer, to comply with BS5839 Part 1 and to meet the requirements of an L2 system, and linked to church alarm system.

This fire strategy plan has been designed to RIBA Stage 3, and should not be used for construction. The fire strategy will be developed in further detail during RIBA stage 4

**FIRE STRATEGY KEY:**

- FIRE SERVICES ACCESS 
- FINAL EXIT 
- ESCAPE ROUTE 
  
- 60 min FIRE PROTECTION 
- 30 min FIRE PROTECTION 
  
- BREAK GLASS CALL POINT 
- SURFACE FLAME SPREAD 
  
- ILLUMINATED EXIT SIGN 
- NON ILLUMINATED (NI) FIRE EXIT SIGN 
- FIRE ALARM PANEL 
  
- ALARM DETECTOR / SOUNDER (Smoke) 
- ALARM DETECTOR / SOUNDER (Heat) 
- FIRE EXTINGUISHER 

Notes

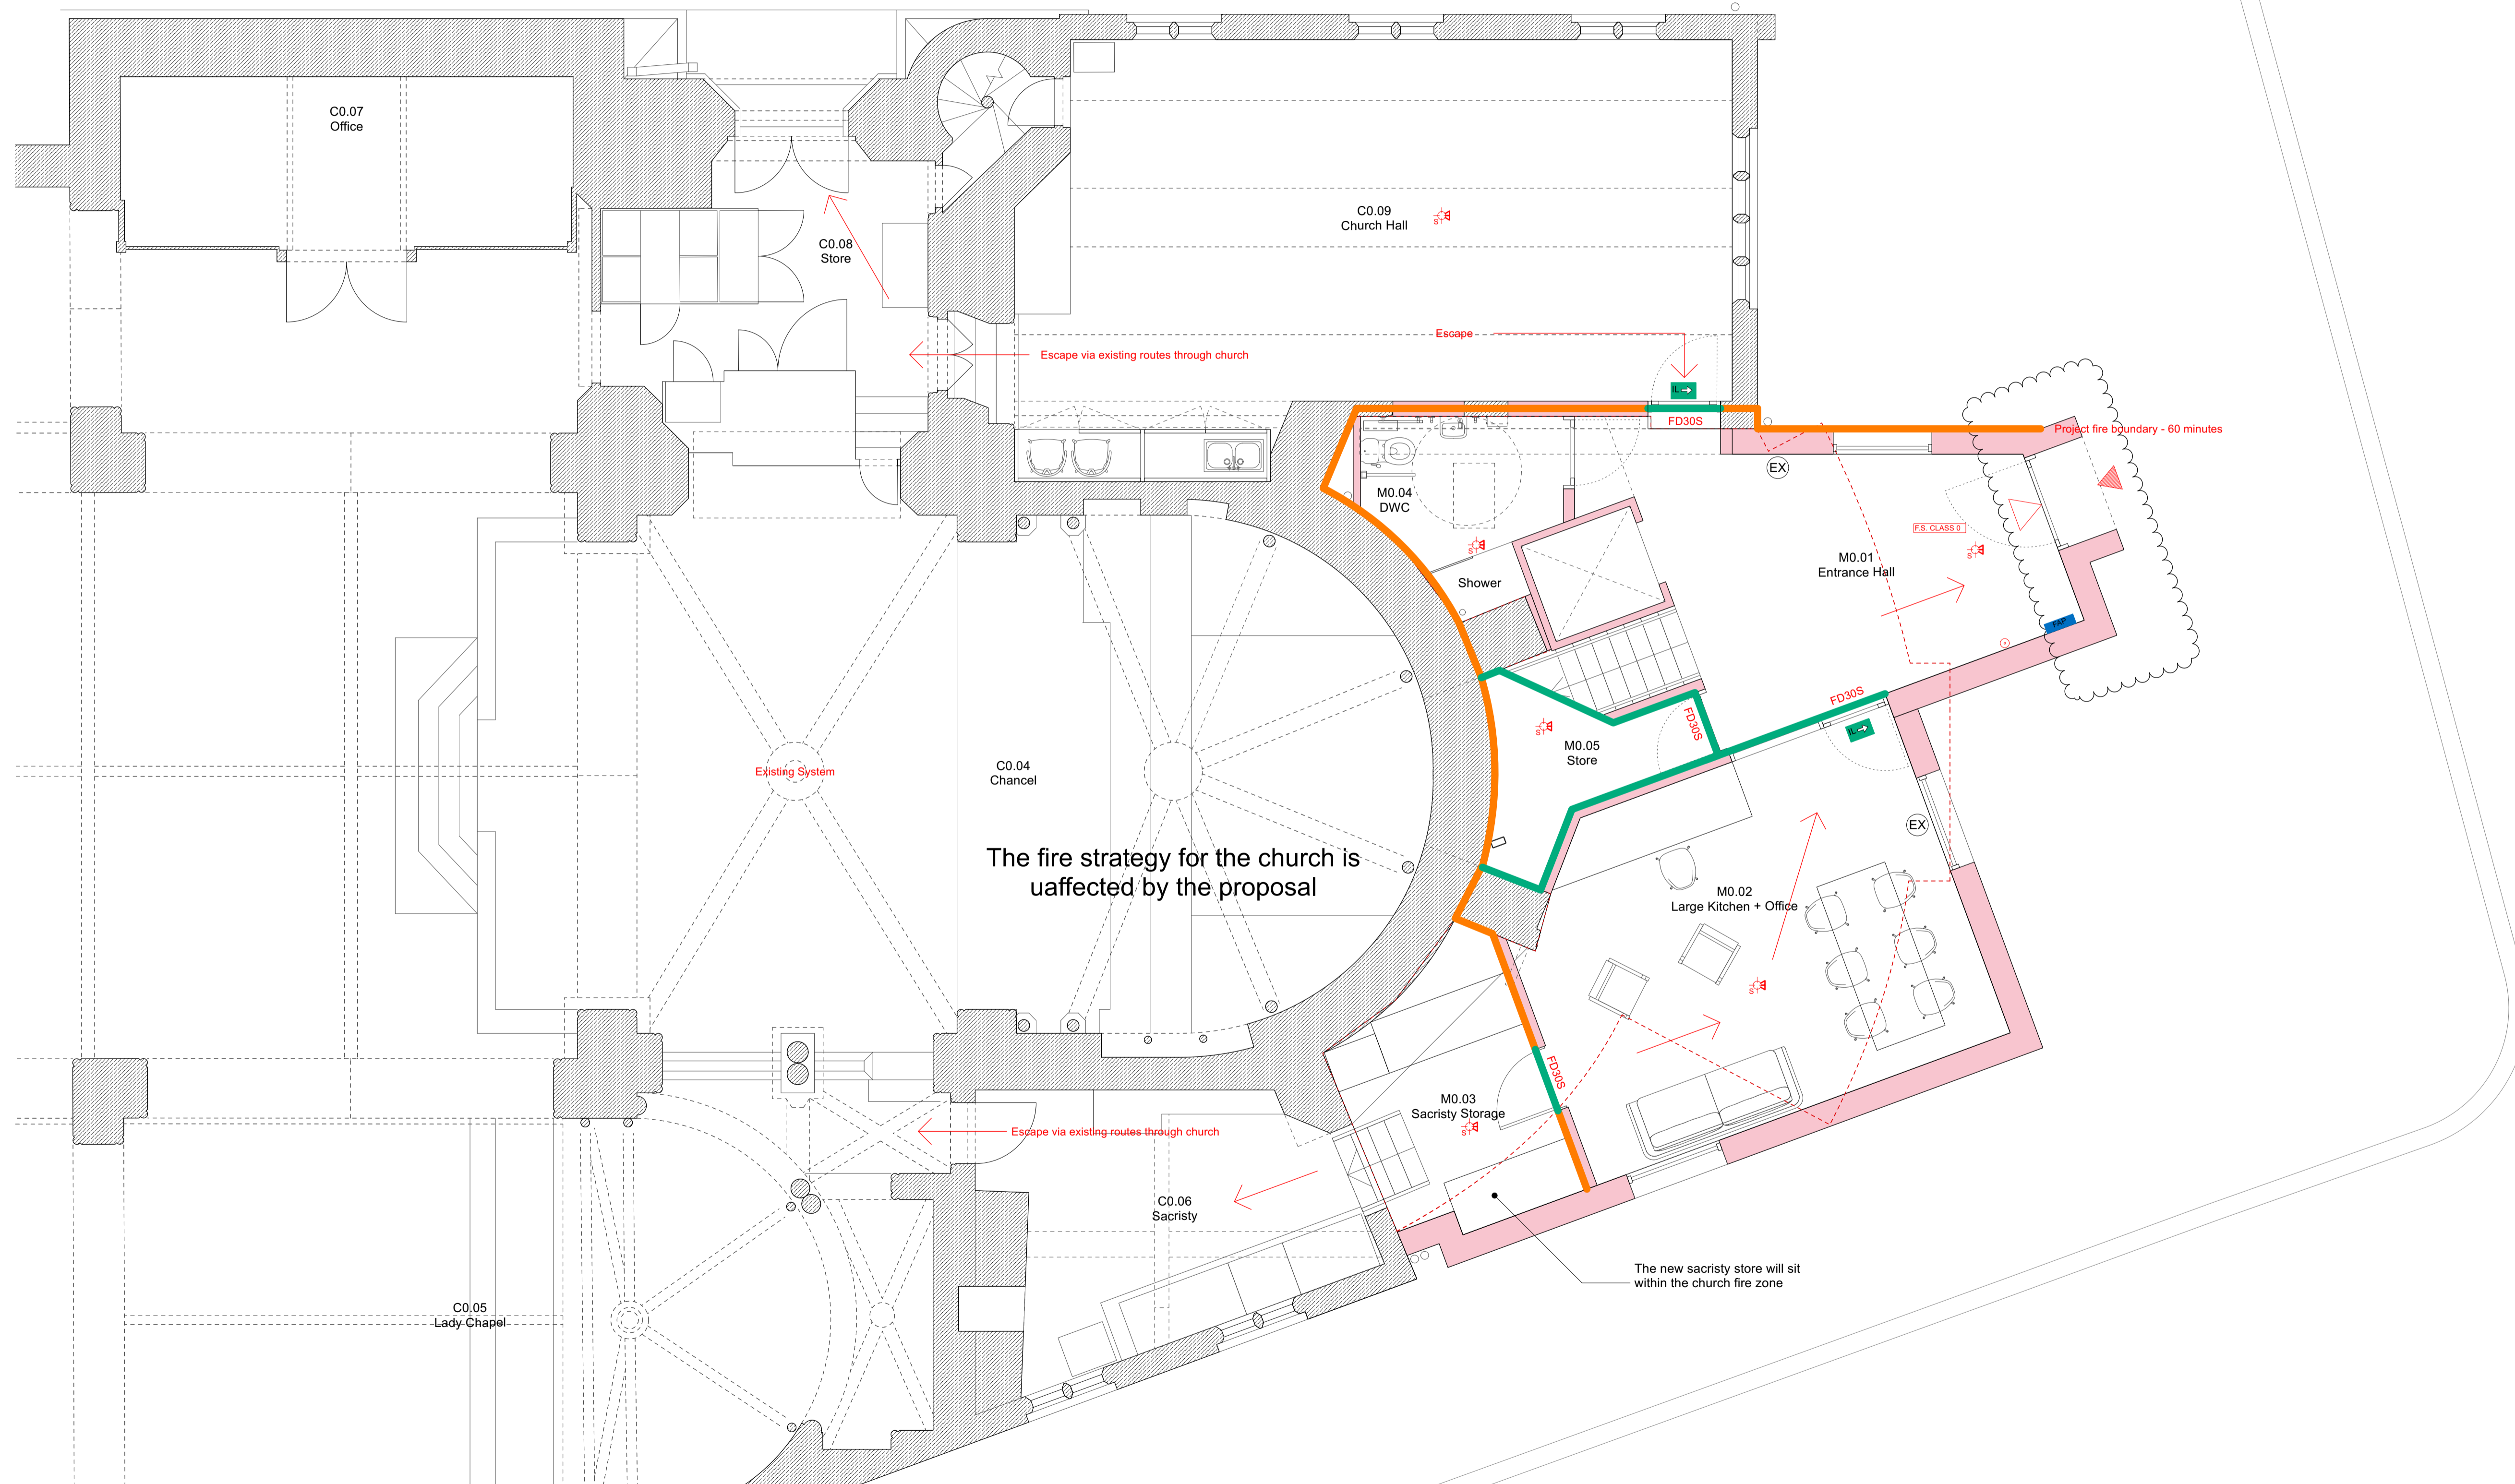

The fire strategy for the church is unaffected by the proposal

The new sacristy store will sit within the church fire zone

**DOW JONES ARCHITECTS**

10 Station Parade, Balham High Road, London, SW12 9AZ  
 T 020 8675 2544  
 mail@dowjonesarchitects.com  
 www.dowjonesarchitects.com

**St Mary's Primrose Hill**  
 Ground Floor Fire Plan Proposed  
 1:50 @ A1  
 01.06.2022  
 STATUS: Planning

430-68-100 P1