


- Existing entrance lobby ceiling (unaffected)
- Underside of circle rake
- Existing closer re-used
- Existing wall
- 16mm Pyrobel fire rated glass
- Timber glass beads to match existing
- Timber door and frame to match existing and box office timber structure adjacent
- Existing brass plates/ handles re-used

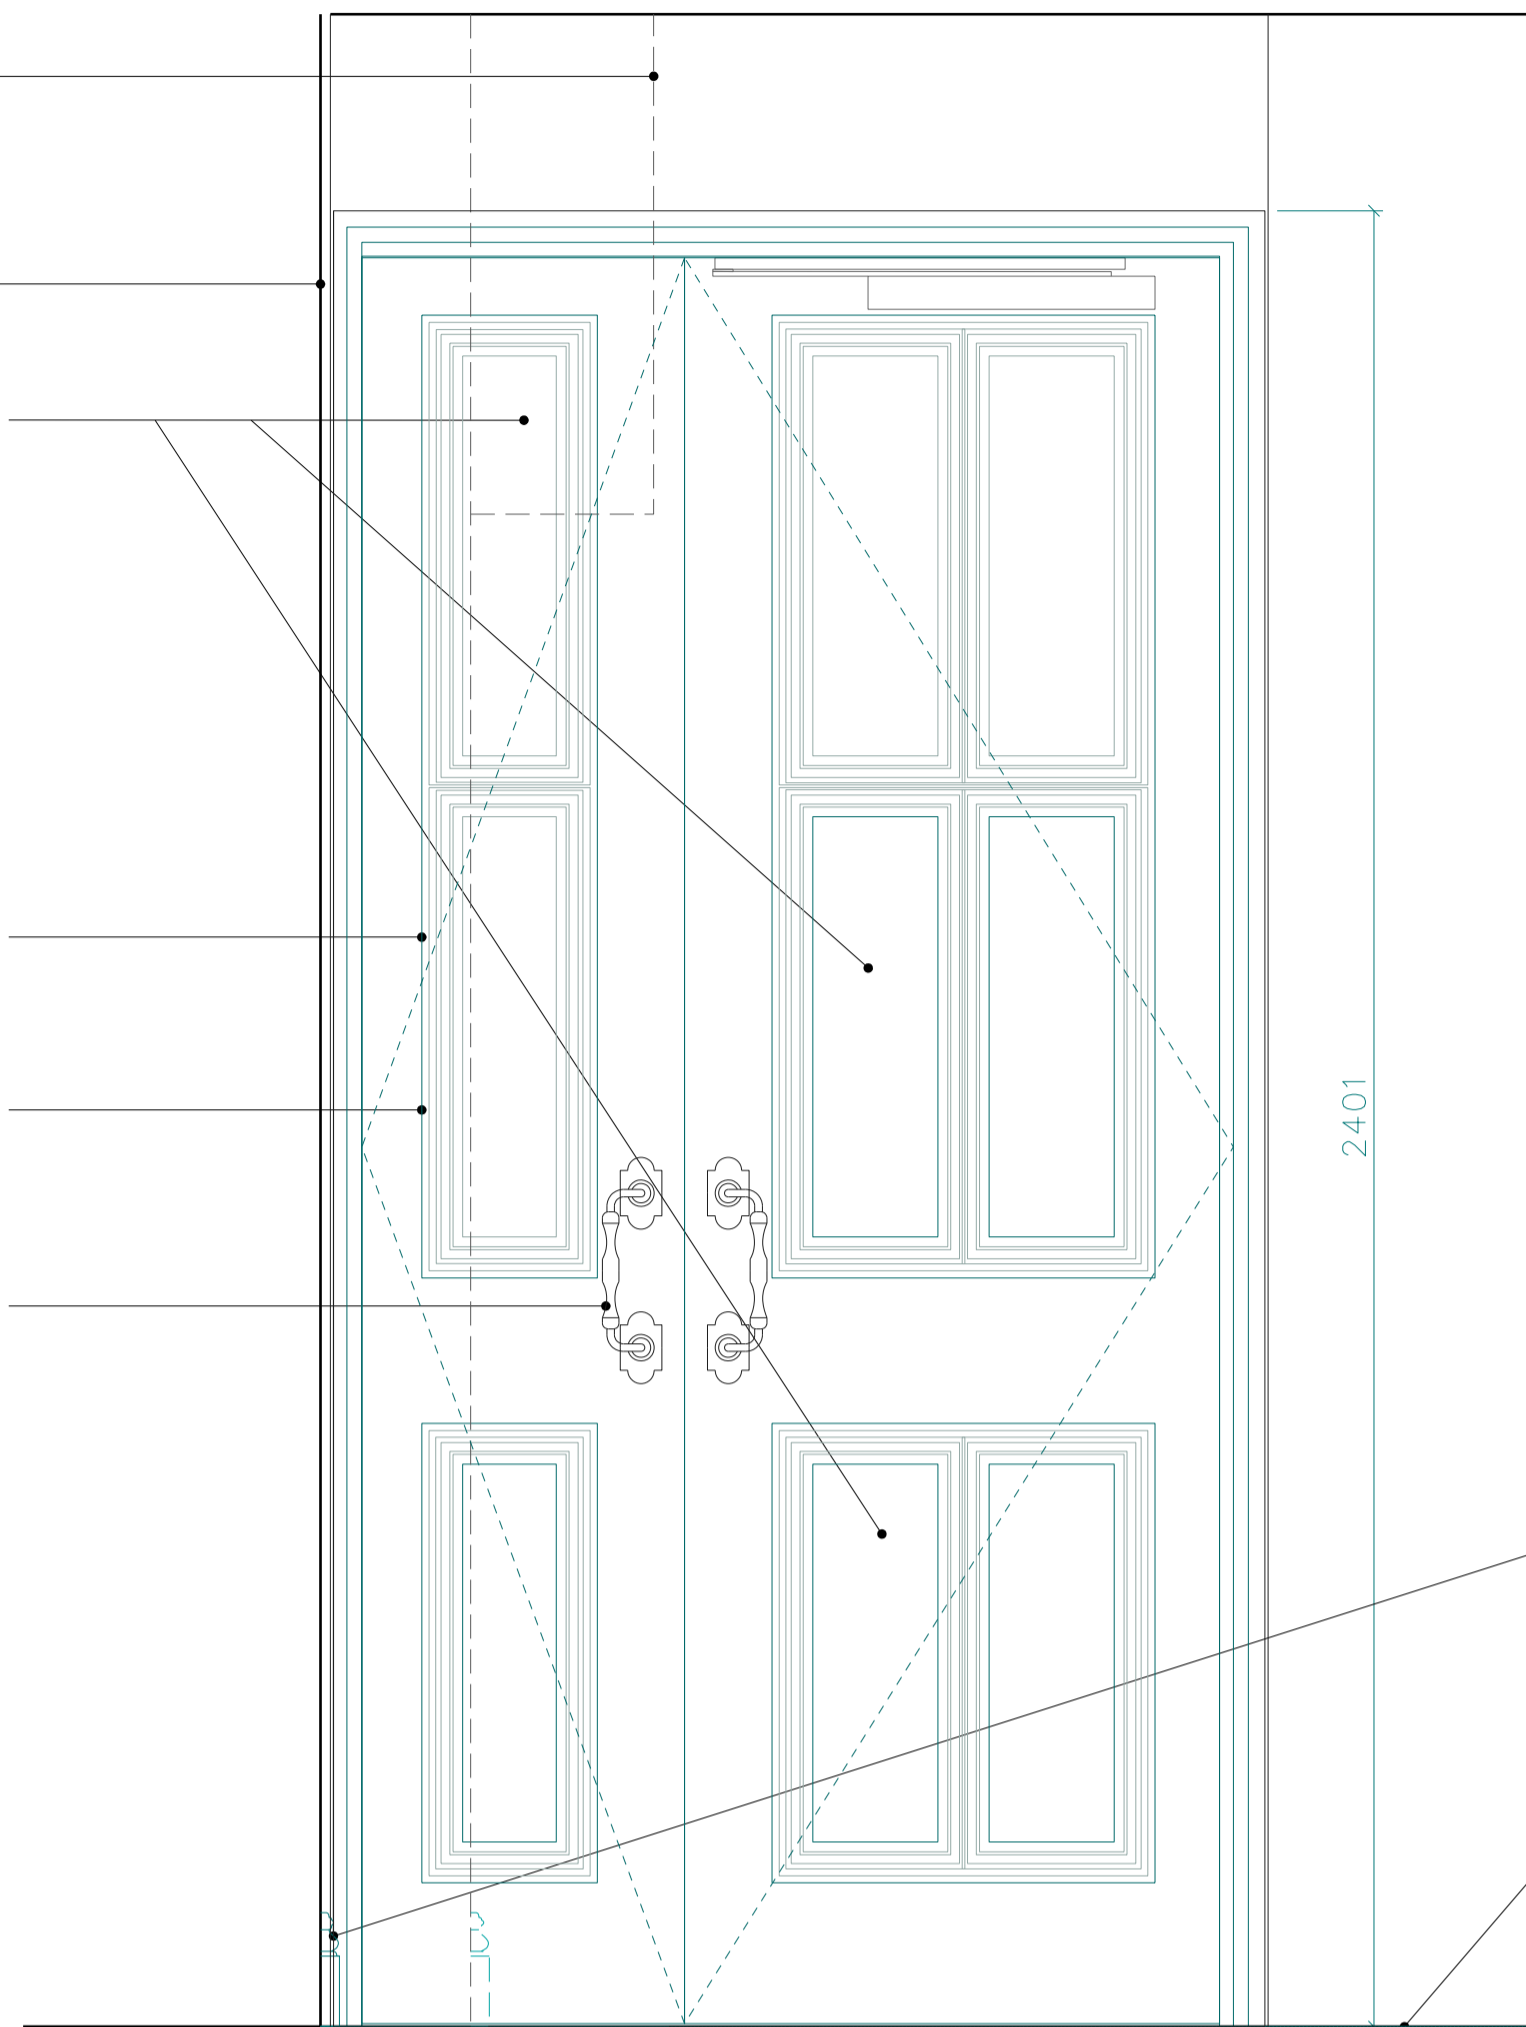


- New timber skirtings to match existing
- New carpet finish

2  
710

New door to front entrance lobby


3  
710

New door to front entrance lobby

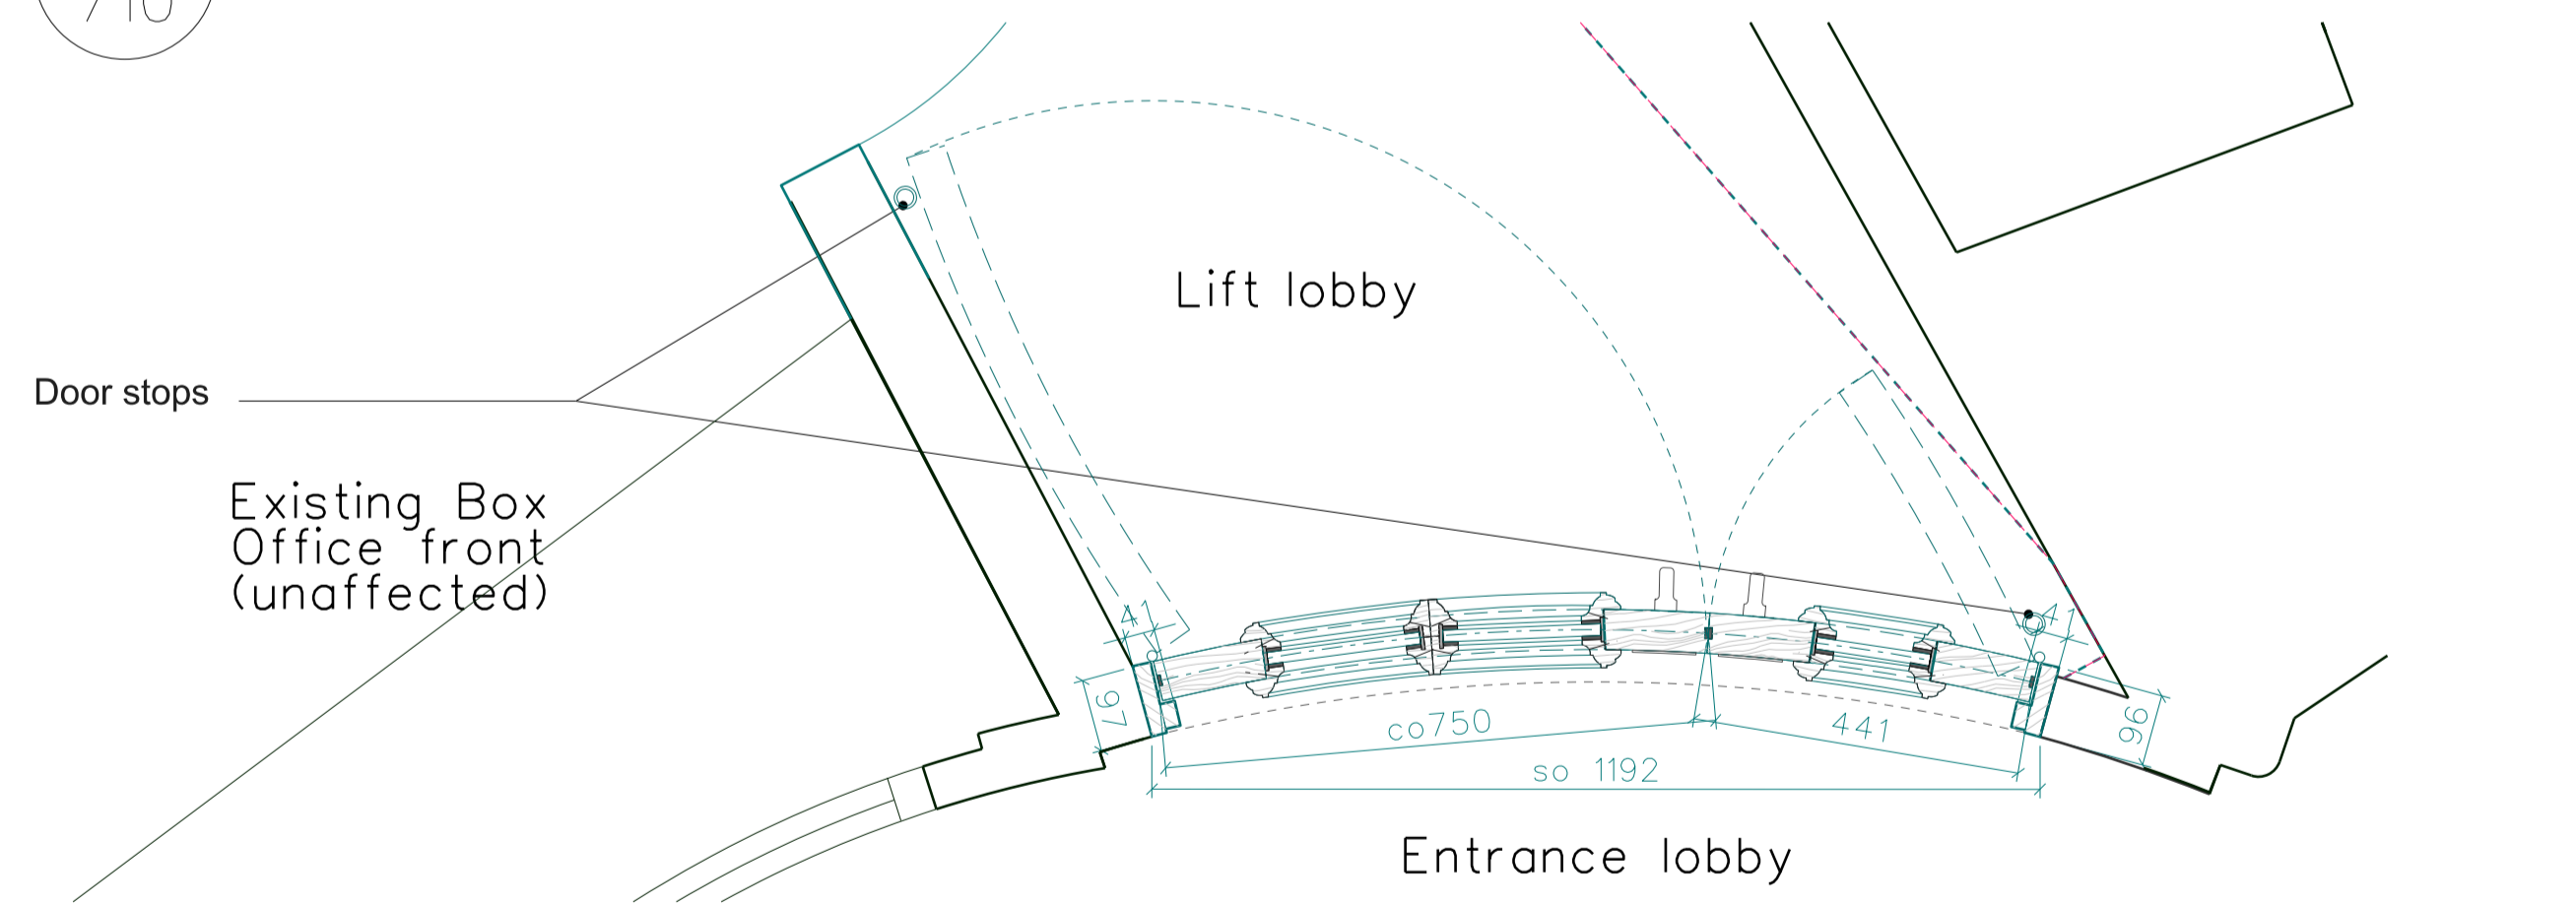

1  
710

New door to front entrance lobby

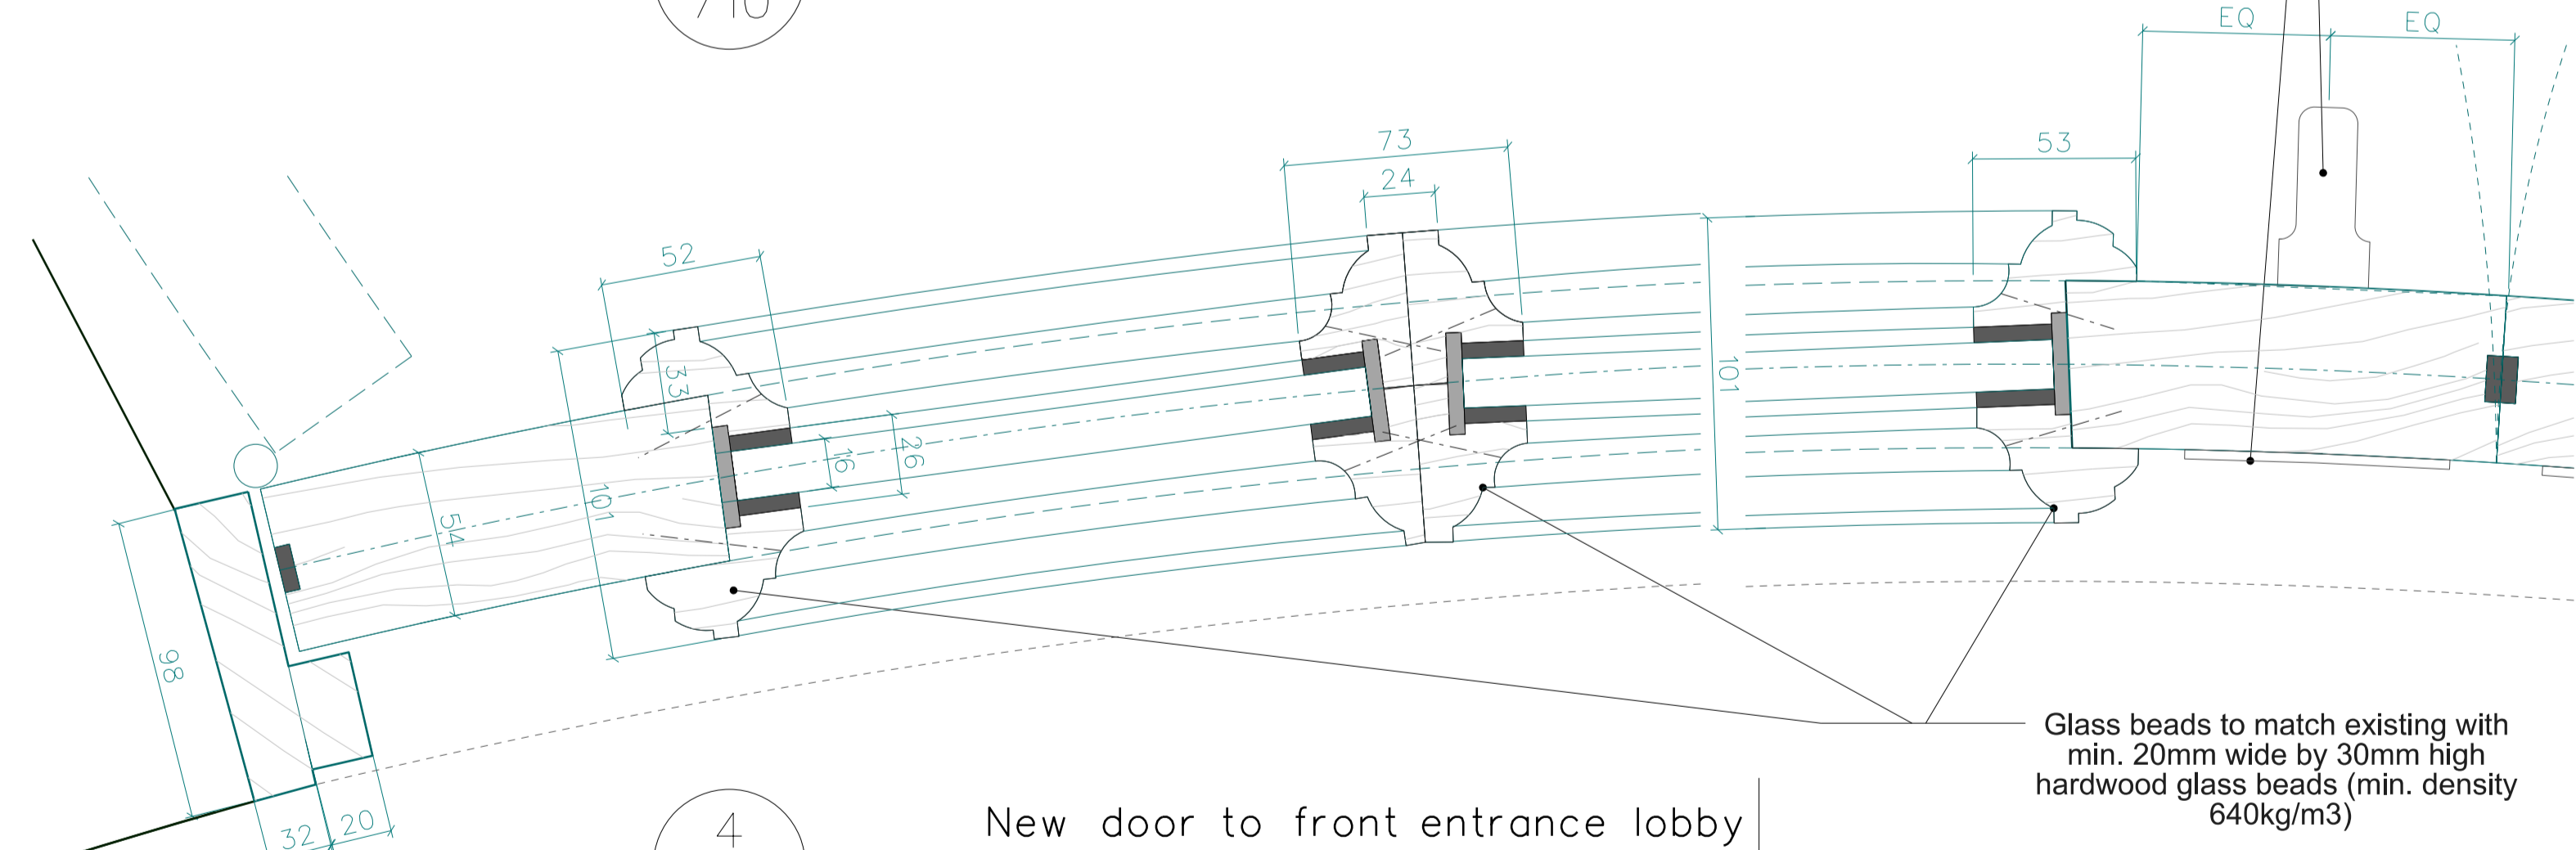

4  
710

New door to front entrance lobby

Plan Detail 1:5

- Key
- Existing
  - Existing structure altered
  - Proposed

**Note:**  
 New door required to entrance lobby to allow for wheelchair access to new lift as current door is one leaf only (co 525mm), with a fixed side panel.  
 New timber door to fit within existing opening  
 New door to be a 54mm FD30s timber curved double door to match the existing door.  
 Timber used for the making of the door to be min. density 650kg/m3.  
 The master leaf is to allow co 750mm to meet BC requirements for existing listed buildings.  
 New glass panels to be Pyrobel 16mm Fire Rated glass (or equivalent approved), with min. 20mm wide by 30mm high hardwood glass beads (min. density 640kg/m3).  
 Use 60mm long screws or pins for beads fixings, 4x12mm closed cell black foam tape and non combustible/ hardwood setting blocks as glass gaskets.  
 New timber door and frame finish to match existing and box office timber structure adjacent  
 Install 15x5mm intumescent brown smoke seal onto door leaves  
 Refer to Certifire No CF377 - AGC Glass UK Ltd for further requirements

THE CONTRACTOR IS TO CHECK AND VERIFY ALL BUILDING AND SITE DIMENSIONS, LEVELS AND SEWER INVERT LEVELS AT CONNECTION POINTS BEFORE WORK STARTS  
 THIS DRAWING IS TO BE READ AND CHECKED IN CONJUNCTION WITH ENGINEERS AND OTHER SPECIALIST DRAWINGS  
 THE DRAWING AND THE WORKS DEPICTED ARE THE COPYRIGHT OF THIS PRACTICE AND MAY NOT BE REPRODUCED EXCEPT BY WRITTEN PERMISSION



Rev:	Date:	Description
1	20/09/22	Planning

Job: 2201 Ambassadors Theatre  
 Client: Ambassador Theatre Group  
 Drawing: Curved Door to Box Office/ Lift Lobby  
 Drawing no: 2201-3-710  
 Rev: 1  
 Status: Stage 3  
 Scale: 1:20@A3, 1:10@A1  
 Date: 20/09/22  
 citizensdesignbureau  
 Ground Floor Units 01 & 03, 6 Westgate Street, London, E8 3RN  
 t : 02030959732  
 e : everyone@citizensdesignbureau.net

