


TYPICAL STORM WATER TANK LONG SECTION

SCALE 1:50

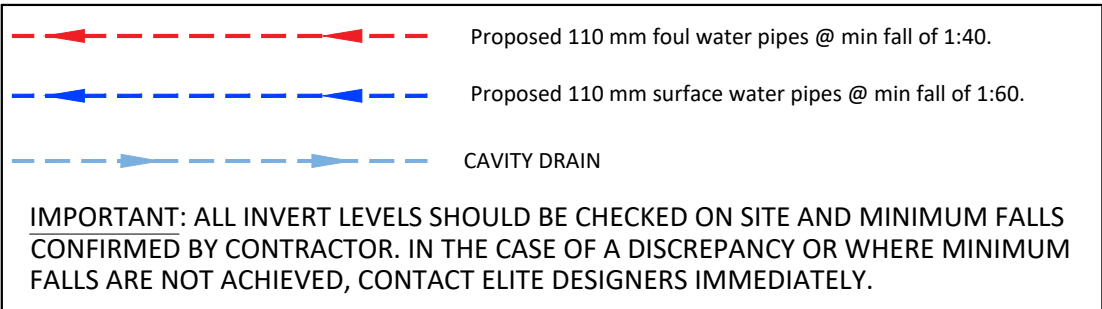

- Notes:
1. This drawing is to be read in conjunction with all relevant architects, engineers & specialist sub-contractors' drawings and the specification.
  2. Any discrepancies between the site conditions and these drawings to be reported to Elite Designers. Dimensions must not be scaled and should be checked on site.
  3. All dimensions are in millimetres, levels are in metres a.o.d. (above ordnance datum).
  4. Foundations have been designed on a safe increase in bearing pressure of 150kN/m<sup>2</sup> into clay strata.
  5. All new steelwork to be grade S355 and be supplied to site blast cleaned to Swedish standard SA2½ painted with high build zinc phosphate alkyl primer to 80 microns after fabrication. Any mechanical damage to coating to be touched up on site in accordance with the specification.
  6. All new steel beams to have a minimum of 100mm bearing either end.
  7. Lengths of all members are to be verified on site by the Contractor.
  8. Catnic type lintels to have a minimum bearing of 150mm either end.
  9. All temporary works to ensure the structural stability of all elements in the temporary state during construction are to be the responsibility of the contractor.
  10. Cover to reinforcement to be 30mm to all bars. 75 mm for structure cast against soil; 35 mm for underpin/retaining wall with shutter, unless noted otherwise.
  11. Checking the location of the existing services in relation to the elements of the new construction works is the responsibility of the principal contractor. Any discrepancy between the existing services and the new construction works should be reported to Elite Designers before the commencement of the works.
  12. The principal contractor is to provide all necessary flexible sleeves or lintels where drainage pipes pass through walls or foundations.
  13. The principal contractor is to ensure that at all times the excavations shall remain free from standing water.
  14. Movement joints to be positioned @ 6m c/c in blockwork and @ 12m c/c in brickwork.
  15. Movement joints to be 15mm hydrocell or similar joint filler with a 15x15mm two part polysulphate sealant (colour and fire resistance of sealant to be advised by architect).
  16. All load bearing blockwork below DPC to be 7N/mm<sup>2</sup> dense concrete block.
  17. Provide Ancon ST1 wall ties in accordance with DD140 @ 450 c/c vertically and @ 900 c/c horizontally, staggered u.n.o.
  18. All bolts to be Grade 8.8 M20 unless noted otherwise.
  19. All insulation details have been produced to comply with relevant regulations where possible. However, the responsibility for checking the compliance and execution of insulation details lies with the main contractor.
  20. Floor joists spanning in excess of 2.5m should be strutted by one or more rows of solid or herringbone strutting as follows:  
Joists <2.5m - None required  
Joists 2.5 - 4.5m - One row required  
Joists >4.5m - Two rows required
  21. All beam end reactions shown are unfactored unless noted otherwise.

FOR PLANNING

C	11/11/22	Attenuation tank added	BK	NN	JGF
B	07/09/22	ISSUED FOR PLANNING	OT	NN	JGF
A	21/09/21	ISSUED FOR TENDER	BK	NN	JGF
Rev.	Date	Description	by	ch'd	app
Project					
2 Wadham Gardens London NW3					
Title					
PROPOSED DRAINAGE GROUND FLOOR PLAN					
C/A					
TBC c/o CN Associates Ltd					
Elite Designers Structural Engineers 3 Priory Court 10-18 Priory Road Purley London SW15 1AZ +44 (0)20 8795 4699 elitedesigners.co.uk					
ed					
Scales (A1)	AS SHOWN	Dis No	Rev.		
Drawn	BK	21/09/21	2021-148-101	C	
Chd(Eng)	NN	21/09/21			
Approved	JGF	21/09/21			