

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER DISCIPLINES, DRAWINGS, SCHEDULES AND SPECIFICATIONS, LEGENDS AND STANDARD DETAILS.
2. THIS DRAWING IS COPYRIGHT AND SHALL NOT BE REPRODUCED WITHOUT PERMISSION.
3. DIMENSIONS GOVERN ON ALL DRAWINGS AND DETAILS. SHOULD ANY DISCREPANCIES BE FOUND WITH THIS DRAWING AND ANY ASSOCIATED DRAWINGS OR SPECIFICATIONS THIS SHOULD BE BROUGHT TO THE ATTENTION OF THE M&E BUILDING SERVICES CONSULTANT IMMEDIATELY.
4. UNLESS OTHERWISE STATED ALL DIMENSIONS ARE IN MILLIMETRES.
5. DO NOT SCALE FROM THIS DRAWING.
6. DIMENSIONS TO BE CHECKED ON SITE BEFORE ANY WORK IS PUT IN HAND OR PREFABRICATED.
7. THIS DRAWING SHOULD ONLY BE USED FOR THE SPECIFIC SERVICES INTENDED.
8. THIS DRAWING SHOWS THE DESIGN INTENT ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE FULL CO-ORDINATION OF THE SERVICES INDICATED ON THIS AND ALL OTHER EXISTING SERVICES.
9. FINAL ACCESS AND SETTING OUT OF SERVICES SHALL BE AGREED BETWEEN THE CLIENTS REPRESENTATIVE AND THE CONTRACTOR.
10. THE PROJECT NOTES ARE TO BE READ IN CONJUNCTION WITH ALL RELEVANT TECHNICAL SPECIFICATIONS.
11. WHERE MECHANICAL SERVICES PASS THROUGH FIRE COMPARTMENTATION CEILING VOIDS, FLOOR VOIDS AND STRUCTURAL WALLS THE CONTRACTOR SHALL SLEEVE/SEAL THE OPENING WITH AN ACOUSTIC AND FIRE SEALANT APPROVED BY THE CLIENTS REPRESENTATIVE.
12. THE CONTRACTOR SHALL REFER TO THE RECORD DRAWING OR REQUEST FROM THE BUILDING OWNER DETAILS OF FIRE COMPARTMENTATION.

**LEGEND:**  
 EXISTING BURIED DISTRICT HEATING PIPE ROUTE.  
 EXISTING TUNNEL SYSTEM.

P01 Planning Issue 22/11/2022 SC PN

P00 Stage 4a - Tender Issue 14/11/2019 SC PN

Rev	Description	Date	Dm	Ch'd

# PLANNING

Status of drawing

**BUROHAPPOLD ENGINEERING**

Camden Mill  
 Lower Bristol Road  
 Bath BA2 3DQ  
 UK


Tel: +44 (0)1225 320600  
 Fax: +44 (0)870 787 4148  
 Email: 0042994@burohappold.com  
 Web: www.burohappold.com

Architect N/A  
 Project UCL Bloomsbury Campus  
 Drg Title Enabling Works  
 Existing District Heating Pipework  
 Removal

Scales @ A1 1:100  
 Drawn by SC  
 Drawing No. UCL-BHE-00-00-DR-AM-800

Job No. 0042994  
 Checked by PN  
 Date 14/11/2019  
 Revision

UCL-BHE-00-00-DR-AM-800 **P01**

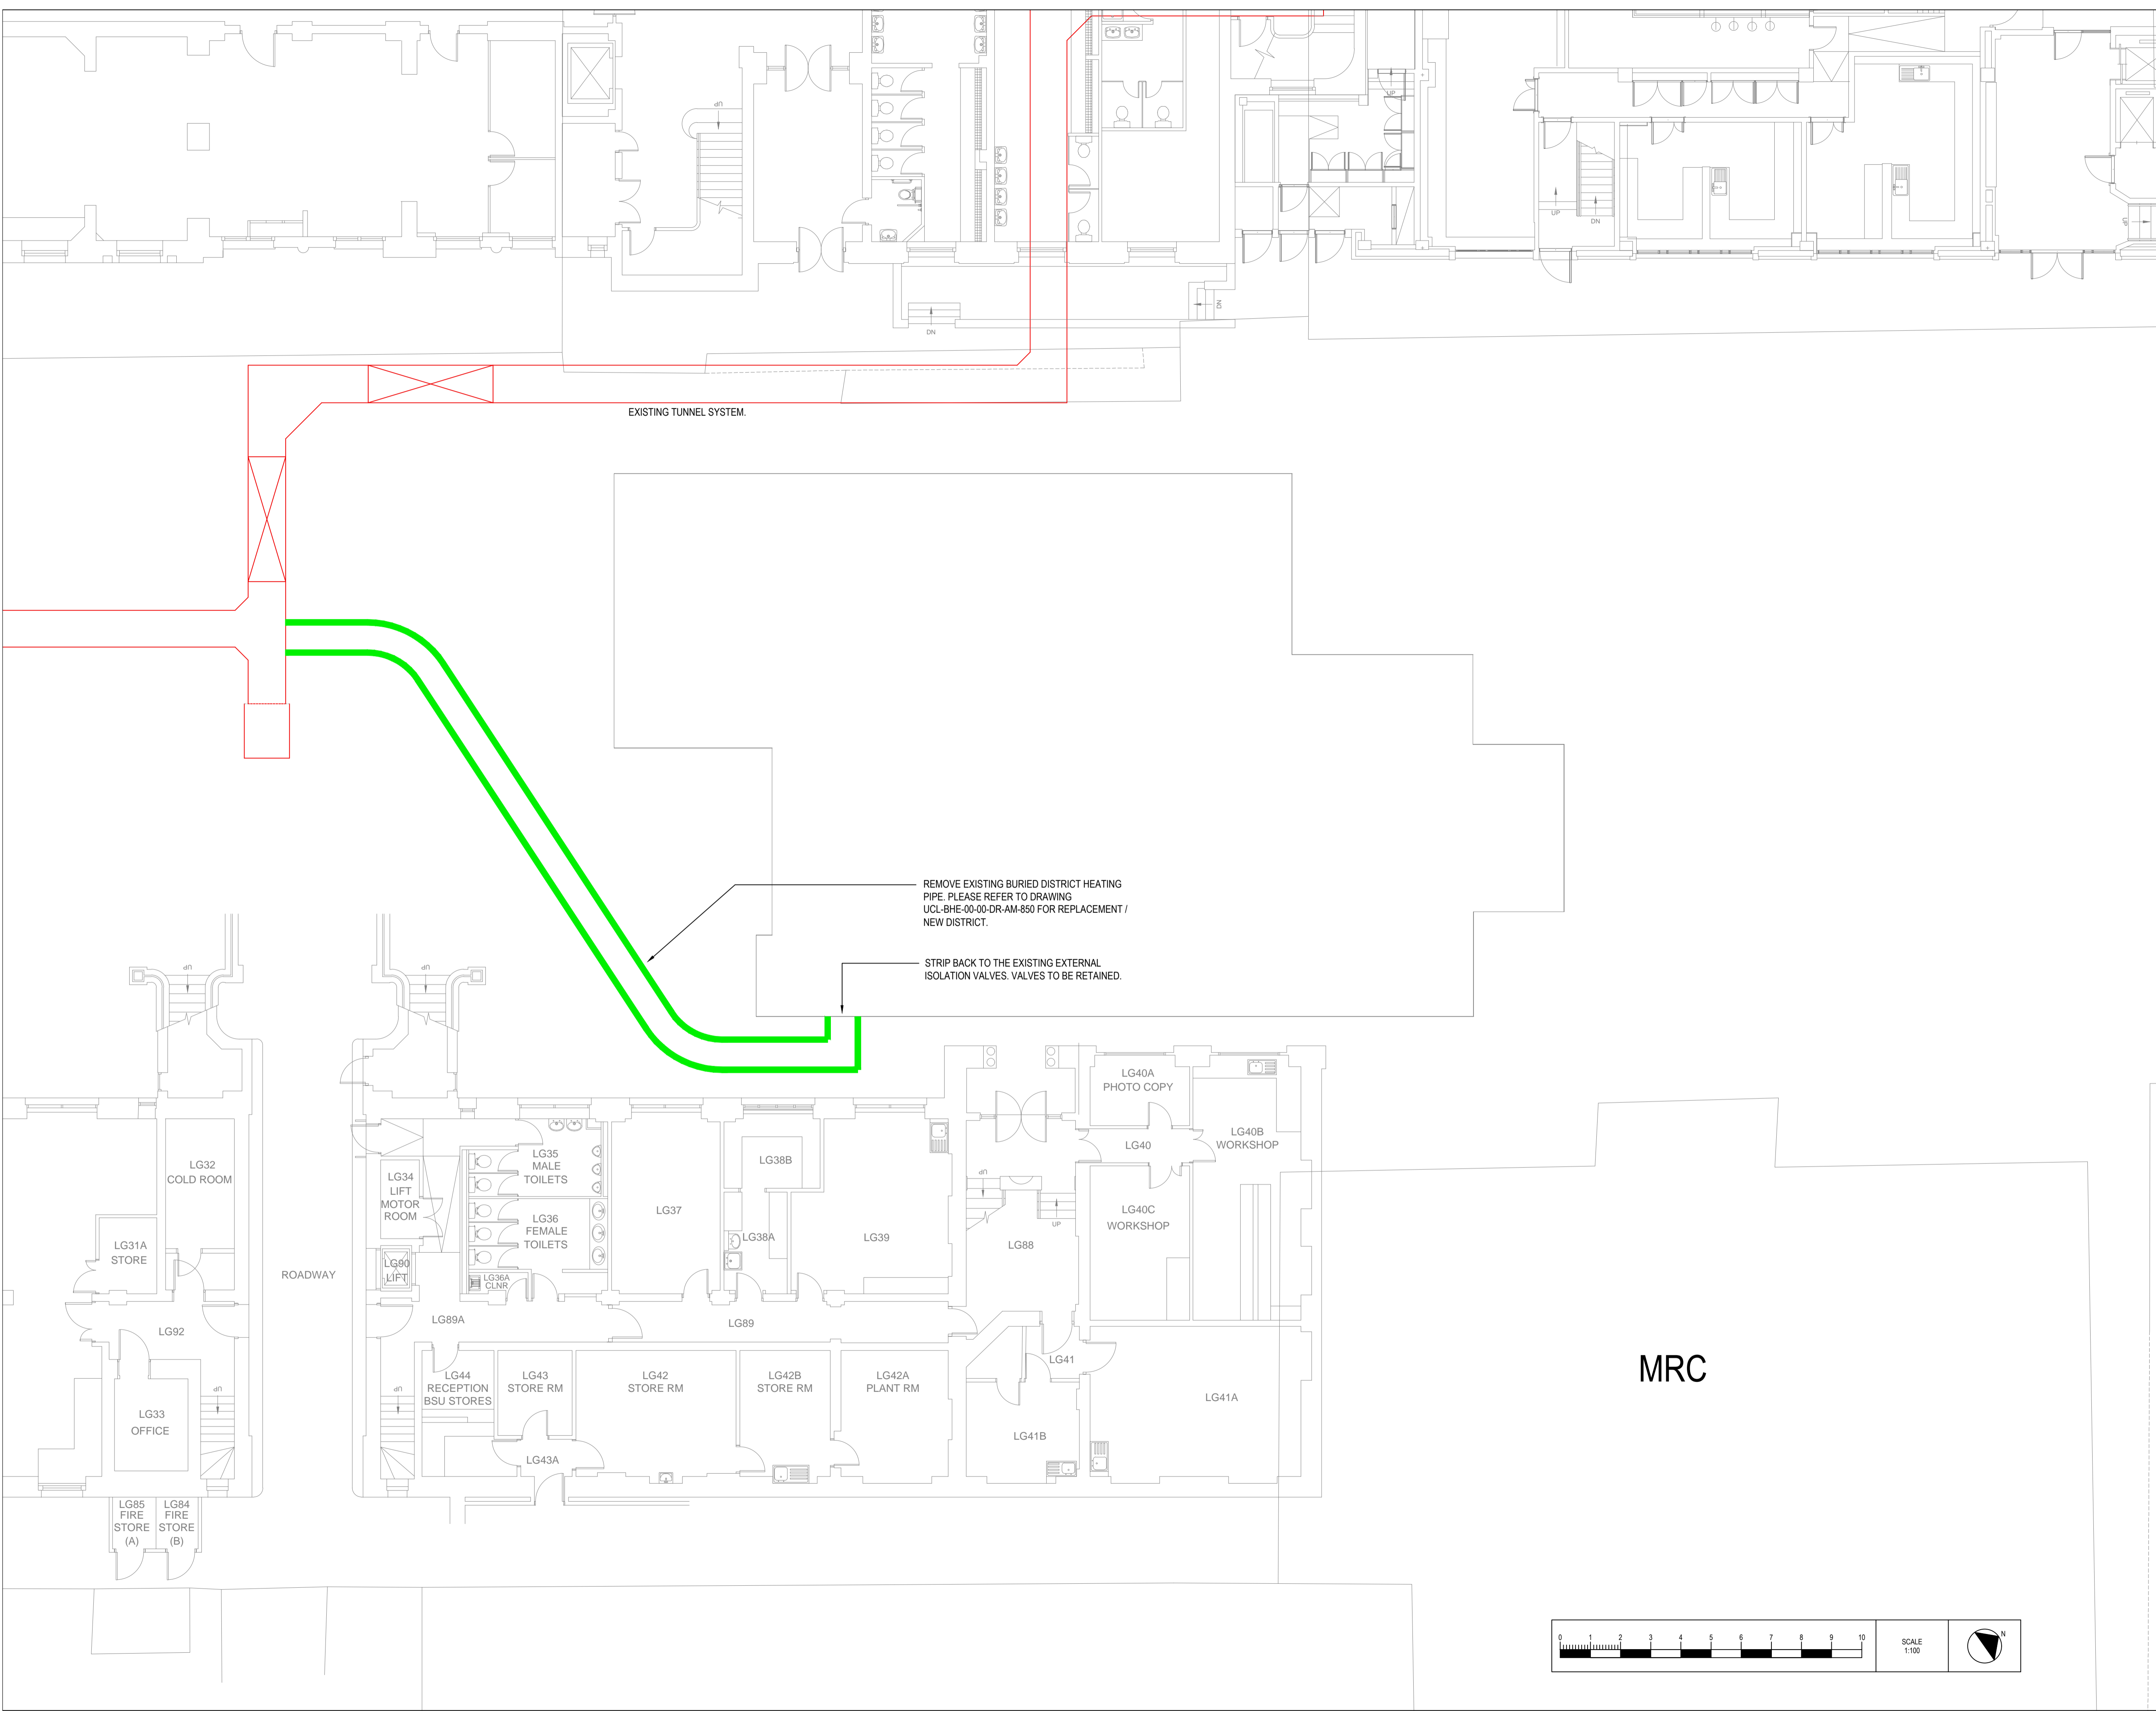

REMOVE EXISTING BURIED DISTRICT HEATING PIPE. PLEASE REFER TO DRAWING UCL-BHE-00-00-DR-AM-850 FOR REPLACEMENT / NEW DISTRICT.  
 STRIP BACK TO THE EXISTING EXTERNAL ISOLATION VALVES. VALVES TO BE RETAINED.

MRC

