


- NOTES**
- ALL DRAWINGS SHALL BE READ IN CONJUNCTION WITH LONG & PARTNERS DRAWINGS, SCHEDULES & SPECIFICATION.
  - FOR DETAILS, ELEVATIONS & EXACT SETTING OUT OF WALL MOUNTED ACCESSORIES, REFER TO THE ARCHITECTS LAYOUT.
  - THE ELECTRICAL SERVICES WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE LONG & PARTNER'S SPECIFICATION.
  - ALL EMERGENCY LUMINAIRES TO BE CONNECTED TO KLK MODULE LOCATED WITHIN THE CEILING VOID. THE CIRCUIT TO BE DERIVED FROM THE LOCAL LIGHTING CIRCUIT.
  - ALL LIGHTING CONTROL LOCATIONS ARE INDICATIVE AND THE MANUFACTURERS INSTALLATION INSTRUCTIONS SHOULD ALWAYS BE CHECKED.

- LEGEND**
- A 1000mm LINEAR RECESSED LED LUMINAIRE
  - A1 1500mm LINEAR RECESSED LED LUMINAIRE
  - A1/S 1500mm SUSPENDED LINEAR LED LUMINAIRE
  - A2 2000mm LINEAR RECESSED LED LUMINAIRE
  - A2/S 3000mm LINEAR SURFACE MOUNTED LED LUMINAIRE
  - A3 1200mm SUSPENDED MOUNTED LED LUMINAIRE
  - A4 2274mm SUSPENDED MOUNTED LED LUMINAIRE TUNBLE BALLAST

- OB RECESSED CIRCULAR LED DOWNLIGHT
- OB1 RECESSED CIRCULAR LED DOWNLIGHT
- OB2 RECESSED CIRCULAR LED DOWNLIGHT
- OB3 RECESSED CIRCULAR LED DOWNLIGHT
- OB4 RECESSED CIRCULAR LED DOWNLIGHT
- OC RECESSED CIRCULAR LED DOWNLIGHT
- OC1 SUSPENDED CIRCULAR LED DOWNLIGHT
- OC2 SUSPENDED LED PENDANT
- OC3 SUSPENDED LED PENDANT
- OD IP65 RATED WALL MOUNTED LUMINAIRE
- LI & L2 IP65 LINEAR SURFACE MOUNTED LED LUMINAIRE
- EM1 SURFACE MOUNTED NON MAINTAINED EMERGENCY DOWNLIGHT (EXTG DENOTES EXISTING)
- EM2 RECESSED CIRCULAR NON MAINTAINED EMERGENCY DOWNLIGHT
- EM3 WALL MOUNTED NON MAINTAINED TWIN SPOTLIGHT EMERGENCY LUMINAIRE
- EXIT R RECESSED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
- EXIT SS SURFACE MOUNTED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
- EXIT S IP RATED SURFACE MOUNTED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
- IP IP RATED SURFACE MOUNTED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
- IP65 IP65 RATED SURFACE MOUNTED LINEAR LED LUMINAIRE
- OH RECESSED CIRCULAR LED DOWNLIGHT
- EX1 IP65 EXTERNAL WALL MOUNTED LUMINAIRE
- AD RECESSED MOUNTED ABSENCE DETECTOR COMBINED WITH DAYLIGHT LINK
- PD RECESSED MOUNTED PRESENCE DETECTOR COMBINED WITH DAYLIGHT LINK
- PD1 SURFACE MOUNTED PRESENCE DETECTOR
- PD2 SURFACE MOUNTED HIGH BAY PRESENCE DETECTOR COMBINED WITH DAYLIGHT LINK
- PD3 WALL MOUNTED MICROWAVE PRESENCE DETECTOR
- IP65 IP65 EXTERNAL WALL MOUNTED PHOTOCCELL SENSOR
- LCM PLUGGABLE DALI LIGHTING CONTROL MODULE WITH FUSED CONNECTION UNIT MOUNTED ADJACENT
- PR2000 EXOR LIGHTING CONTROL POWER SUPPLY UNIT
- EM PANEL ZUMTobel EMERGENCY LIGHTING CONTROL PANEL
- SW LIGHT SWITCH
- R RETRACTABLE LIGHT SWITCH ('X' DENOTES NO. OF GANGS)
- IS INTERMEDIATE LIGHT SWITCH
- SS1 WALL MOUNTED LIGHTING CONTROL SCENE SELECT PLATE
- CV DENOTES ITEM LOCATED WITHIN CEILING VOID
- WP DENOTES WEATHERPROOF ITEMS
- LCM LIGHTING CIRCUIT

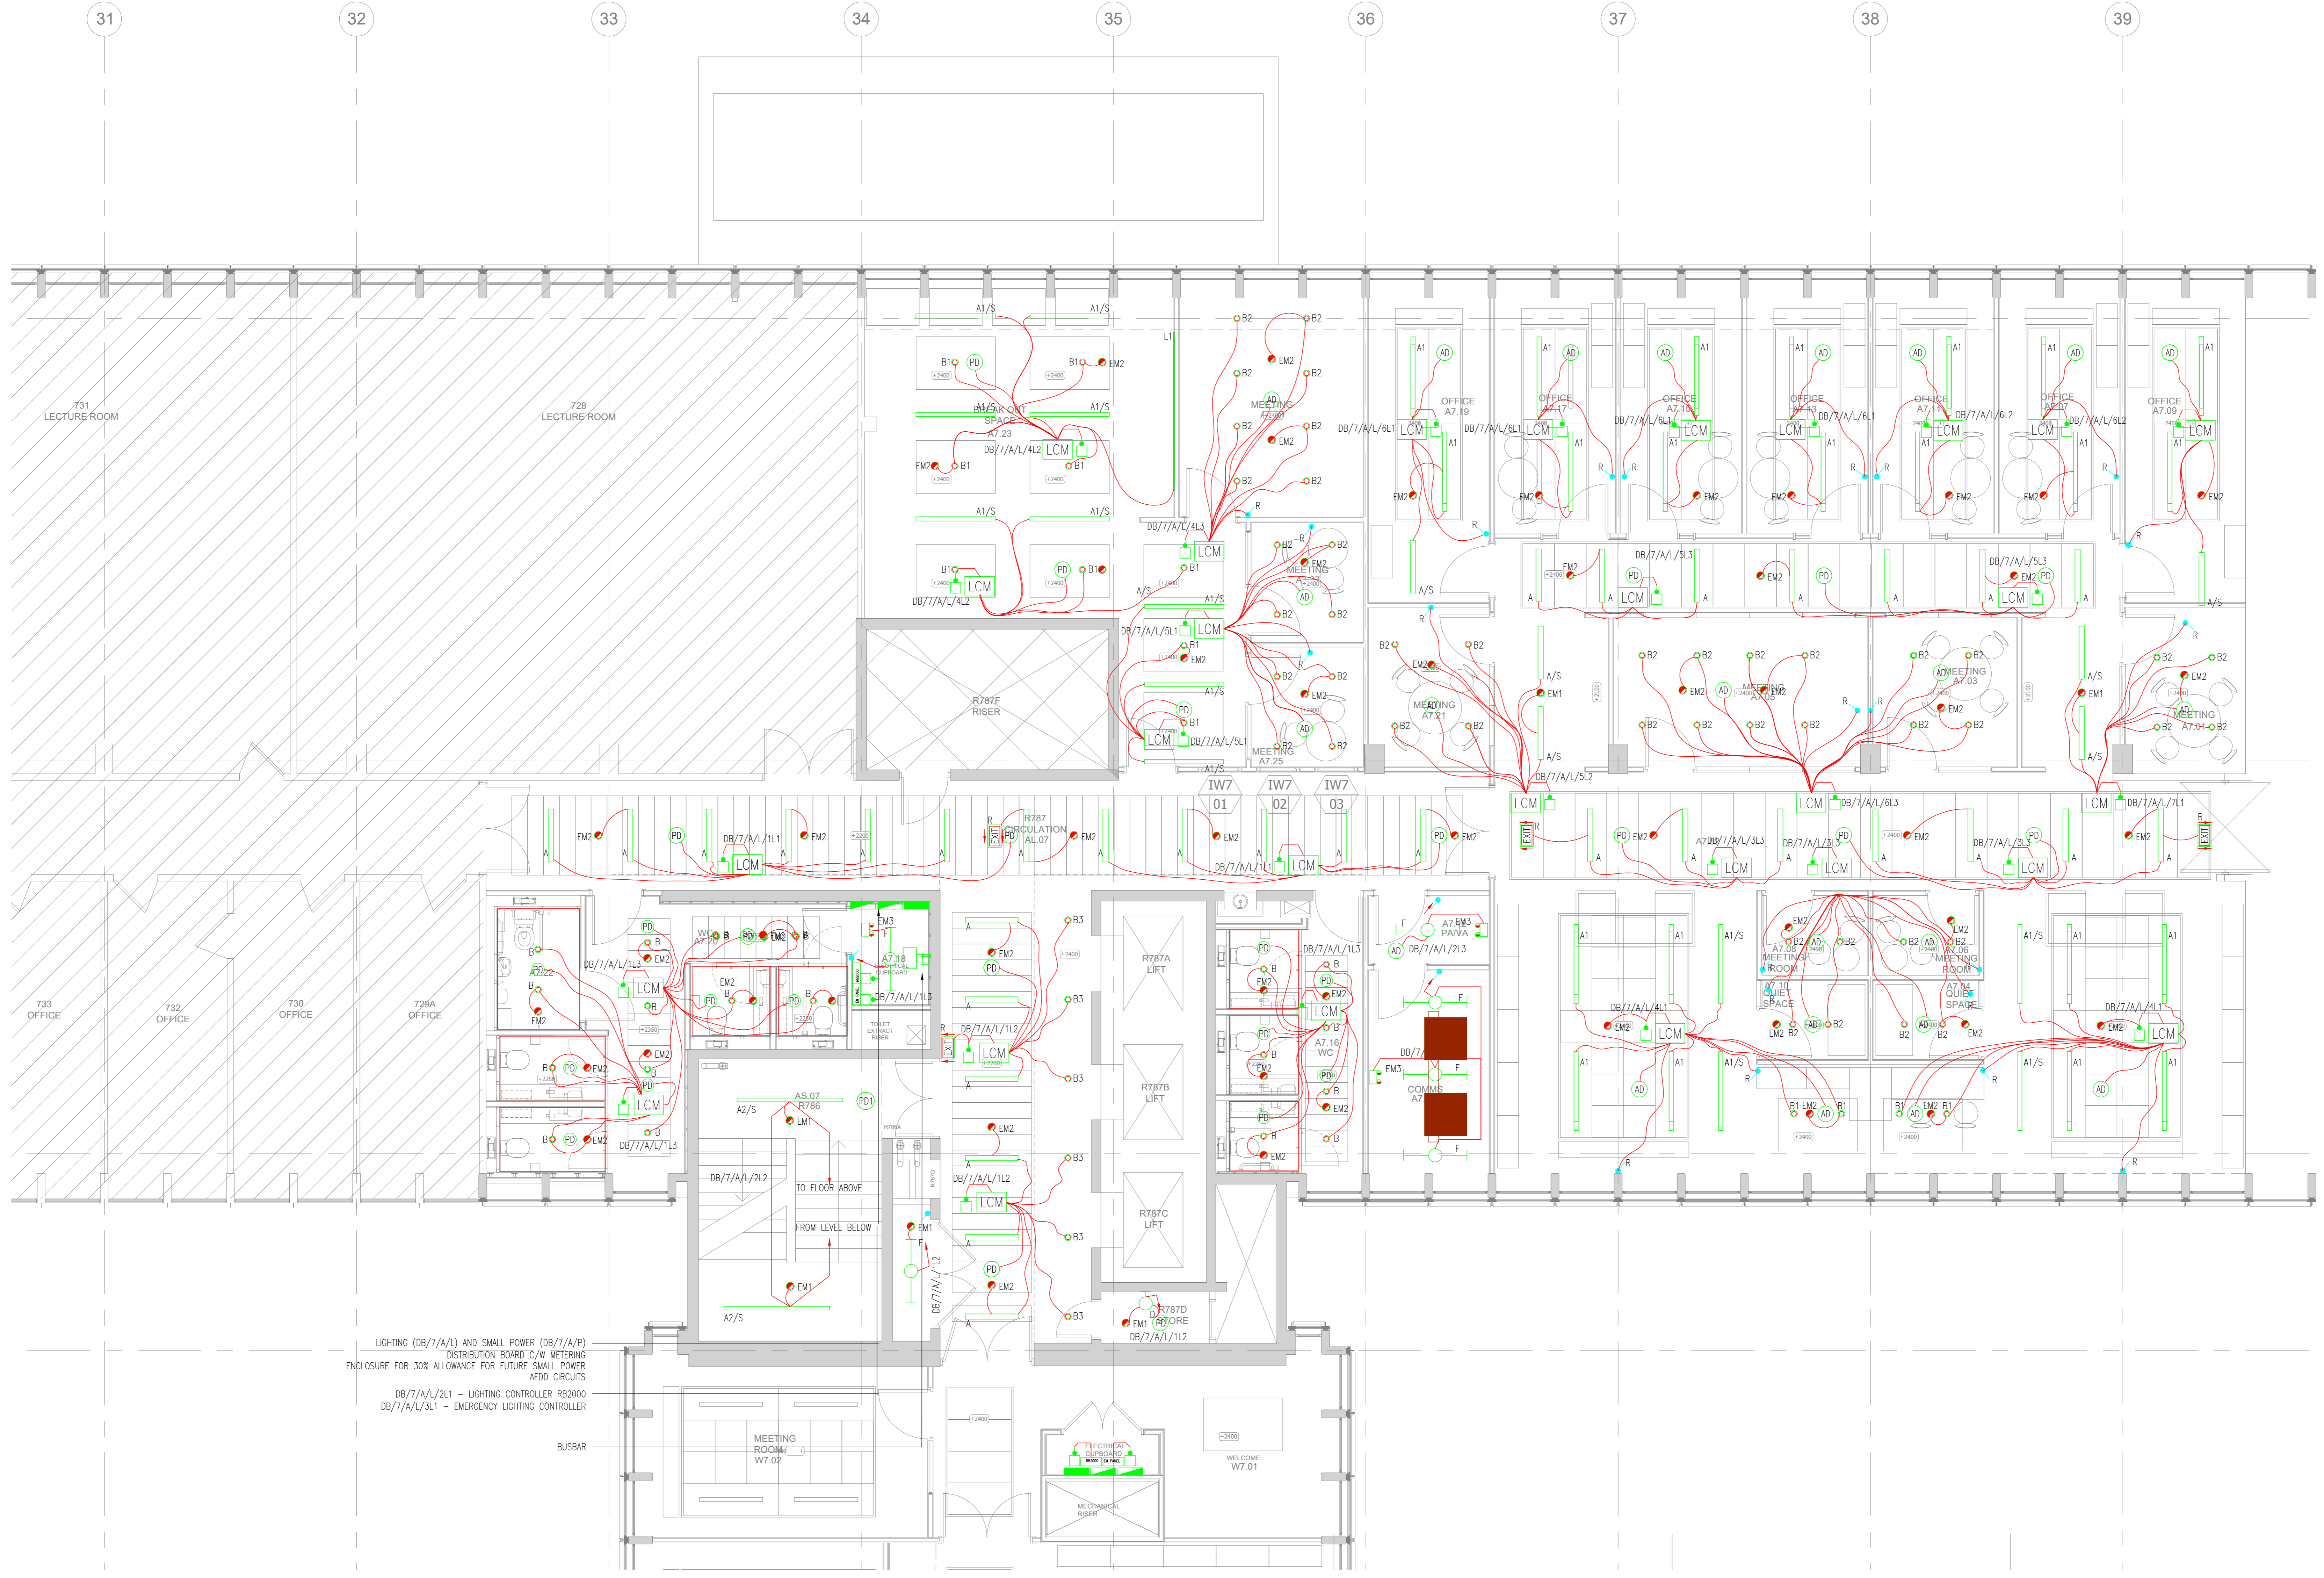

LIGHTING (DB/7/A/L) AND SMALL POWER (DB/7/A/P) DISTRIBUTION BOARD C/W METERING ENCLOSURE FOR 30% ALLOWANCE FOR FUTURE SMALL POWER ADD CIRCUITS  
 DB/7/A/L/2L1 - LIGHTING CONTROLLER PR2000  
 DB/7/A/L/3L1 - EMERGENCY LIGHTING CONTROLLER

FOR CONTINUATION REFER TO DRAWING 20BW-LP-CA-06-DR-E-3007-2

Rev	Date	Description	Drawn
C1	04.10.22	MINOR AMENDMENTS INCORPORATED	CAD
02	06.05.22	CONTRACT ISSUE	CAD
03	06.04.22	STAGE 4 RE-START	CAD
04	15.03.21	REVISED TO SUIT EAZ2	CAD
05	15.01.21	REVISED TO SUIT EAZ2	CAD
06	01.07.2020	STAGE 4 FINAL ISSUE INCORPORATING COMMENTS	CAD
07	15.05.2020	STAGE 4 ISSUE	CAD
08	02.04.2020	STAGE 4 ISSUE	CAD
09	13.03.2020	DRAFT STAGE 4 ISSUE	CAD
10	13.12.19	DRAFT STAGE 3 ISSUE	CAD
11	02.11.19	DRAFT STAGE 3 ISSUE	CAD


Based on architects drawing  
 20BW-ALLP-ZZ-07-DR-A-2705-L7 PLAN

**CONTRACT ISSUE**

Project: UCL IOE, 20 BEDFORD WAY PHASE 2

Title: LEVEL 7 CORE A LIGHTING LAYOUT

Scale	Designed By	Checked by	Date
1:500A0	SN	PEC	NOV'19

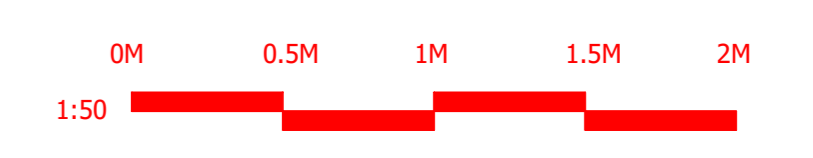

LP-CA-07-DR-E-3007-1 C1