


FOR CONTINUATION REFER TO DRAWING 20BW-LP-CA-07-DR-E-3007-1

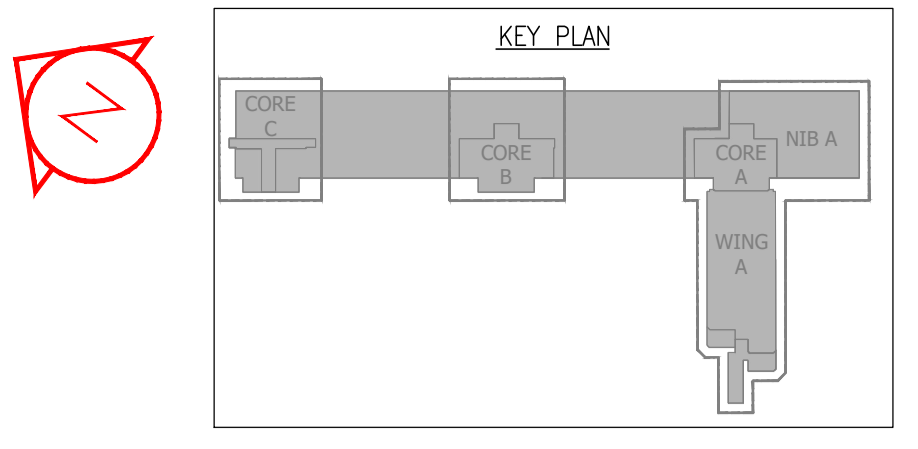

32

33


34

35

36

37

38

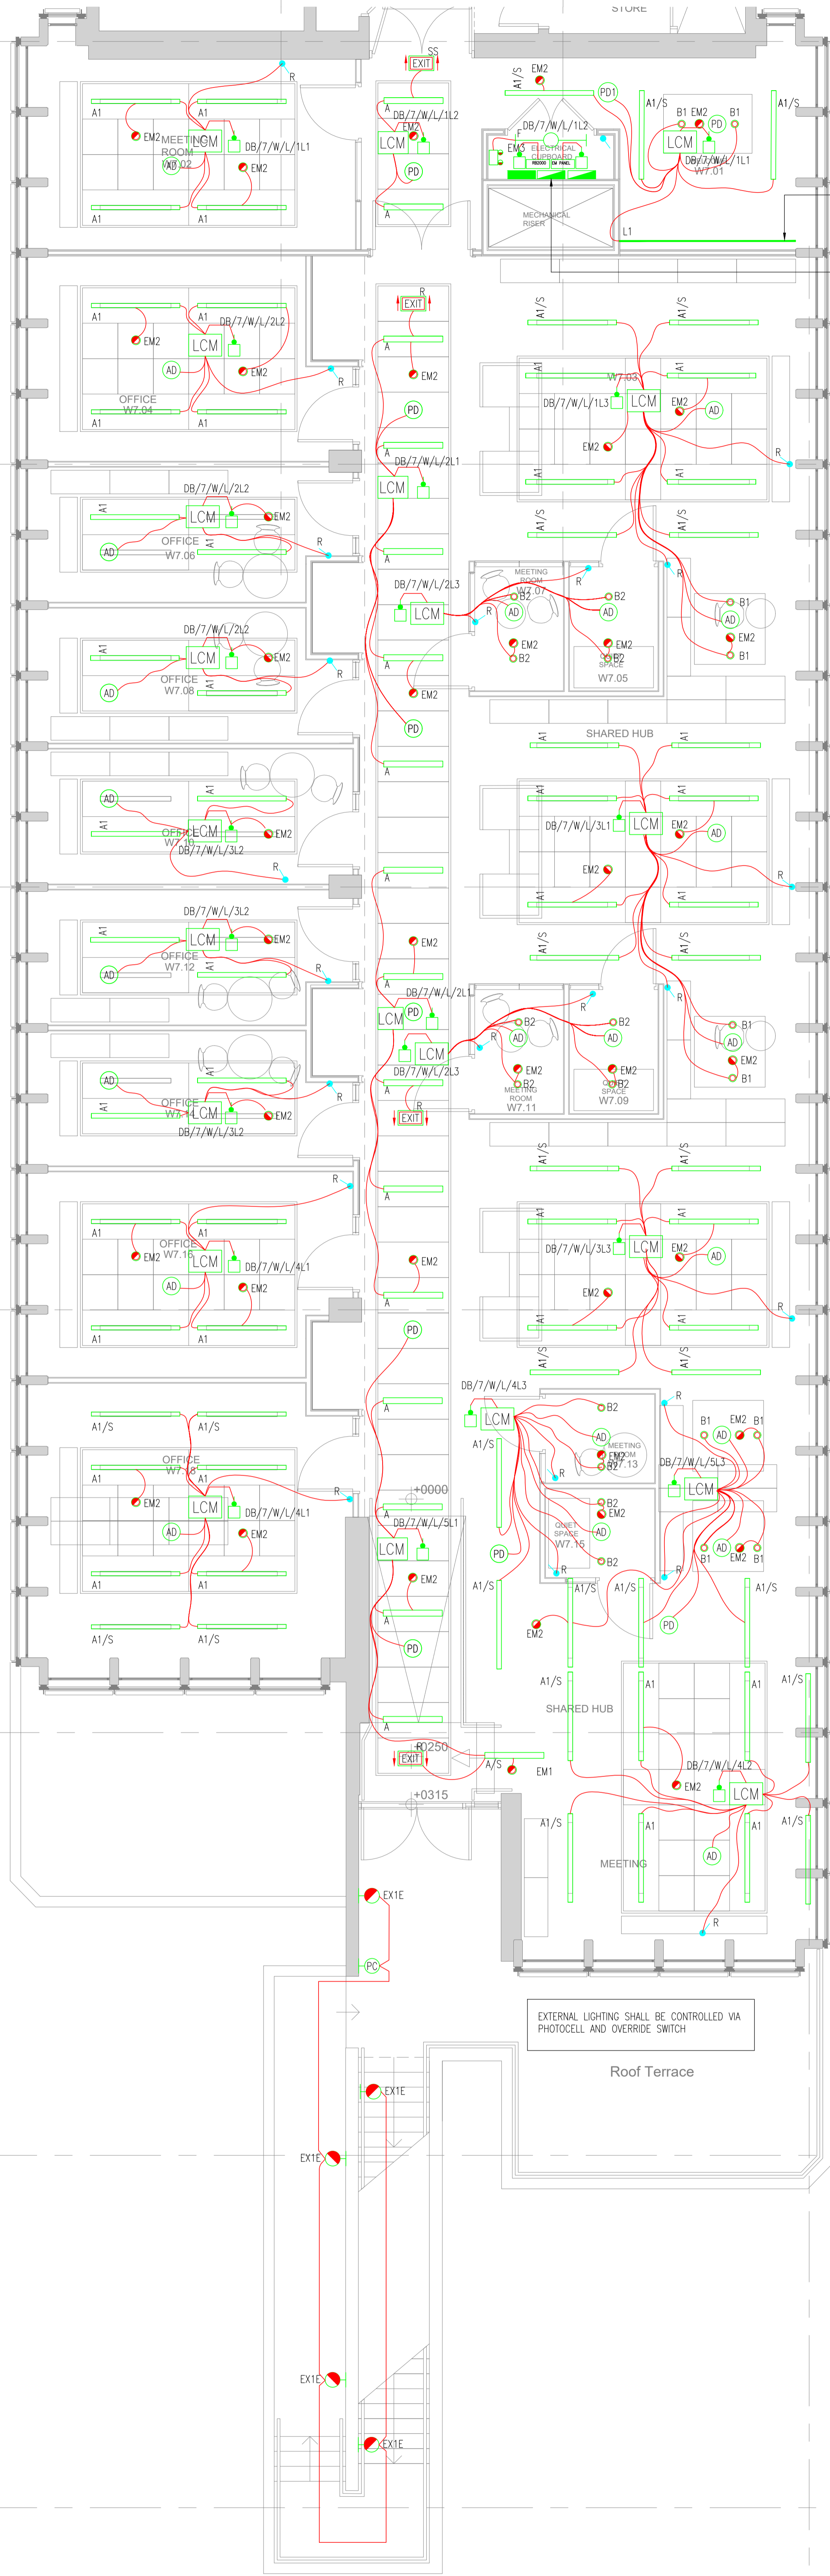

SURFACE MOUNTED LED STRIP LIGHTING TO BE MOUNTED UNDER KITCHEN CABINETS

LIGHTING (DB/7/W/L) AND SMALL POWER (DB/7/W/P) DISTRIBUTION BOARD C/W METERING ENCLOSURE FOR 30% ALLOWANCE FOR FUTURE SMALL POWER AFDD CIRCUITS

LIGHTING CONTROL AREA CONTROLLER - DB/7/W/L/SL2
EMERGENCY LIGHTING AREA CONTROLLER - DB/7/W/EL2

EXTERNAL LIGHTING SHALL BE CONTROLLED VIA PHOTOCELL AND OVERRIDE SWITCH

Roof Terrace

- NOTES
- ALL DRAWINGS SHALL BE READ IN CONJUNCTION WITH LONG & PARTNERS DRAWINGS, SCHEDULES & SPECIFICATION
 - FOR DETAILS, ELEVATIONS & EXACT SETTING OUT OF WALL MOUNTED ACCESSORIES, REFER TO THE ARCHITECTS LAYOUT.
 - THE ELECTRICAL SERVICES WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE LONG & PARTNERS SPECIFICATION
 - ALL EMERGENCY LUMINAIRES TO BE CONNECTED TO KLIX MODULE LOCATED WITHIN THE CEILING VOID. THE CIRCUIT TO BE DERIVED FROM THE LOCAL LIGHTING CIRCUIT
 - ALL LIGHTING CONTROL LOCATIONS ARE INDICATIVE AND THE MANUFACTURERS INSTALLATION INSTRUCTIONS SHOULD ALWAYS BE CHECKED

- LEGEND
- A 1000mm LINEAR RECESSED LED LUMINAIRE
 - A1 1500mm LINEAR RECESSED LED LUMINAIRE
 - A1/S 1500mm SUSPENDED LINEAR LED LUMINAIRE
 - A2 2000mm LINEAR RECESSED LED LUMINAIRE
 - A2/S 3000mm LINEAR SURFACE MOUNTED LED LUMINAIRE
 - A3 1200mm SUSPENDED MOUNTED LED LUMINAIRE
 - A4 2274mm SUSPENDED MOUNTED LED LUMINAIRE TUNABLE BALLAST
 - B RECESSED CIRCULAR LED DOWNLIGHT
 - B1 RECESSED CIRCULAR LED DOWNLIGHT
 - B2 RECESSED CIRCULAR LED DOWNLIGHT
 - B3 RECESSED CIRCULAR LED DOWNLIGHT
 - B4 RECESSED CIRCULAR LED DOWNLIGHT
 - C RECESSED CIRCULAR LED DOWNLIGHT
 - C1 SUSPENDED CIRCULAR LED DOWNLIGHT
 - C2 SUSPENDED LED PENDANT
 - C3 SUSPENDED LED PENDANT
 - D IP65 RATED WALL MOUNTED LUMINAIRE
 - L1 & L2 IP65 LINEAR SURFACE MOUNTED LED LUMINAIRE
 - EM1 SURFACE MOUNTED NON MAINTAINED EMERGENCY DOWNLIGHT (EX2 DENOTES EXISTING)
 - EM2 RECESSED CIRCULAR NON MAINTAINED EMERGENCY DOWNLIGHT
 - EM3 WALL MOUNTED NON MAINTAINED TWIN SPOTLIGHT EMERGENCY LUMINAIRE
 - EXIT R RECESSED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
 - EXIT SS SURFACE MOUNTED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
 - EXIT S IP RATED SURFACE MOUNTED MAINTAINED ILLUMINATED LED EMERGENCY EXIT SIGN C/W RUNNING MAN PICTOGRAM
 - F IP65 RATED SURFACE MOUNTED LINEAR LED LUMINAIRE
 - H RECESSED CIRCULAR LED DOWNLIGHT
 - EX1 IP65 EXTERNAL WALL MOUNTED LUMINAIRE
 - AD RECESSED MOUNTED ABSENCE DETECTOR COMBINED WITH DAYLIGHT LINK
 - PD RECESSED MOUNTED PRESENCE DETECTOR COMBINED WITH DAYLIGHT LINK
 - PD1 SURFACE MOUNTED PRESENCE DETECTOR
 - PD2 SURFACE MOUNTED HIGH BAY PRESENCE DETECTOR COMBINED WITH DAYLIGHT LINK
 - PD3 WALL MOUNTED MICROWAVE PRESENCE DETECTOR
 - PC IP65 EXTERNAL WALL MOUNTED PHOTOCELL SENSOR
 - LCM PLUGGABLE DALI LIGHTING CONTROL MODULE WITH FUSED CONNECTION UNIT MOUNTED ADJACENT
 - RR2000 EXOR LIGHTING CONTROL POWER SUPPLY UNIT
 - EM PANEL ZUMTobel EMERGENCY LIGHTING CONTROL PANEL
 - LS LIGHT SWITCH
 - R RETRACTABLE LIGHT SWITCH ('X' DENOTES NO. OF GANGS)
 - ILS INTERMEDIATE LIGHT SWITCH
 - SSS WALL MOUNTED LIGHTING CONTROL SCENE SELECT PLATE
 - 'CV' DENOTES ITEM LOCATED WITHIN CEILING VOID
 - 'WP' DENOTES WEATHERPROOF ITEMS
 - LIGHTING CIRCUIT

Rev	Date	Description	Drawn
C1	04.10.22	MINOR AMENDMENTS INCORPORATED	CAD
C0	06.05.22	CONTRACT ISSUE	CAD
7	06.04.22	STAGE 4 RE-START	CAD
6	15.01.21	REVISED TO SUIT EA20	CAD
5	01.07.2020	STAGE 4 FINAL ISSUE	CAD
		INCORPORATING COMMENTS	
4	15.05.2020	STAGE 4 ISSUE COMMENTS	CAD
3	08.04.2020	STAGE 4 ISSUE	CAD
2	27.03.2020	DRAFT STAGE 4 ISSUE	CAD
1	13.12.19	STAGE 3 ISSUE	CAD
0	22.11.19	DRAFT STAGE 3 ISSUE	CAD

Based on architects drawing
20BW-ALLP-ZZ-07-DR-A-2705-L7 PLAN

Issue status
CONTRACT ISSUE

Project
UCL IOE, 20 BEDFORD WAY
PHASE 2

Title
LEVEL 7 WING
LIGHTING LAYOUT

Scale	Designed By	Checked by	Date
1:50@A0	SN	PEC	NOV'19



7110-20BW-LP-CA-07-DR-E-3007-2 C1

