

Dimensions to be verified on site. Use figured dimensions only. Do not work from reduced scale drawings. Please refer to scale and sheet size as indicated.

DO NOT SCALE

leonard
design architects

4th floor, Albion House
5-13 Canal Street, Nottingham.
NG1 7EG, United Kingdom
www.leonarddesignarchitects.com
t. +44 (0) 115 945 0080
e. office@leonarddesignarchitects.com

Consultants

Copyright Notice

This drawing is the property of LEONARD DESIGN ARCHITECTS LTD. Copyright is reserved by them and the drawing is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorised person without the prior consent in writing of Leonard Design Architects Ltd. All rights reserved.
This drawing was prepared for use on a specific site contemporaneously with its issue date and it is not suitable for use on a different project site or at a later time. Use of this drawing for reference or example on another project requires the services of properly licensed architects and engineers. Reproduction of this drawing for reuse on another project is not authorised and may be contrary to the law.

Revisions

REV	DATE	DESCRIPTION
1	21/10/22	UPDATED LICENSING & NFZ

EN7392

EN7392
156 WEST END LANE,
WEST HAMPSSTEAD,
LONDON,
NW6 1SD

Project Manager:
J.CALLAGHAN
Checked By:
S.DICKENS
Drawn by:
N.STEWART
Document date:
21 JULY 2022

Project No.
1254

Professional Seal

Sheet Size - A1 Revision - 1

Sheet Title
LICENSING PLAN






Sheet No.
RE-200



FIRE EXTINGUISHER LEGEND

1. ALL FIRE EXTINGUISHERS SHALL BE INSTALLED IN THE LOCATION(S) SHOWN. QUANTITY, TYPE(S) AND LOCATION(S) OF FIRE EXTINGUISHERS ARE MINIMUM REQUIRED. ADDITIONAL LOCATIONS OR TYPES OF FIRE EXTINGUISHERS MAY BE REQUIRED BY THE FIRE OFFICER OR UPON EMPLOYERS FIRE RISK ASSESSMENT.
2. FOR INFORMATION ON FIRE EXTINGUISHER REF EQUIPMENT SCHEDULE.
3. ANY FURTHER FIRE FIGHTING EQUIPMENT REQUIREMENTS SUCH AS OTHER TYPES OF EXTINGUISHERS REQUIRES TO BE DETERMINED WITHIN EMPLOYERS FIRE RISK ASSESSMENT.
4. QUANTITY SHOWN: 3 - 9 LITRE WATER FIRE EXTINGUISHER
3 - 2KG CO2 FIRE EXTINGUISHER

- (WH) WALL HUNG
- (FM) FLOOR MOUNTED

EGRESS LEGEND

-  ILLUMINATED EXIT SIGN W/ DIRECTIONAL ARROWS
-  ILLUMINATED EXIT SIGN
-  CUSTOMER ENTRY POINT
-  CUSTOMER EXIT POINT
-  STAFF ONLY ACCESS POINT

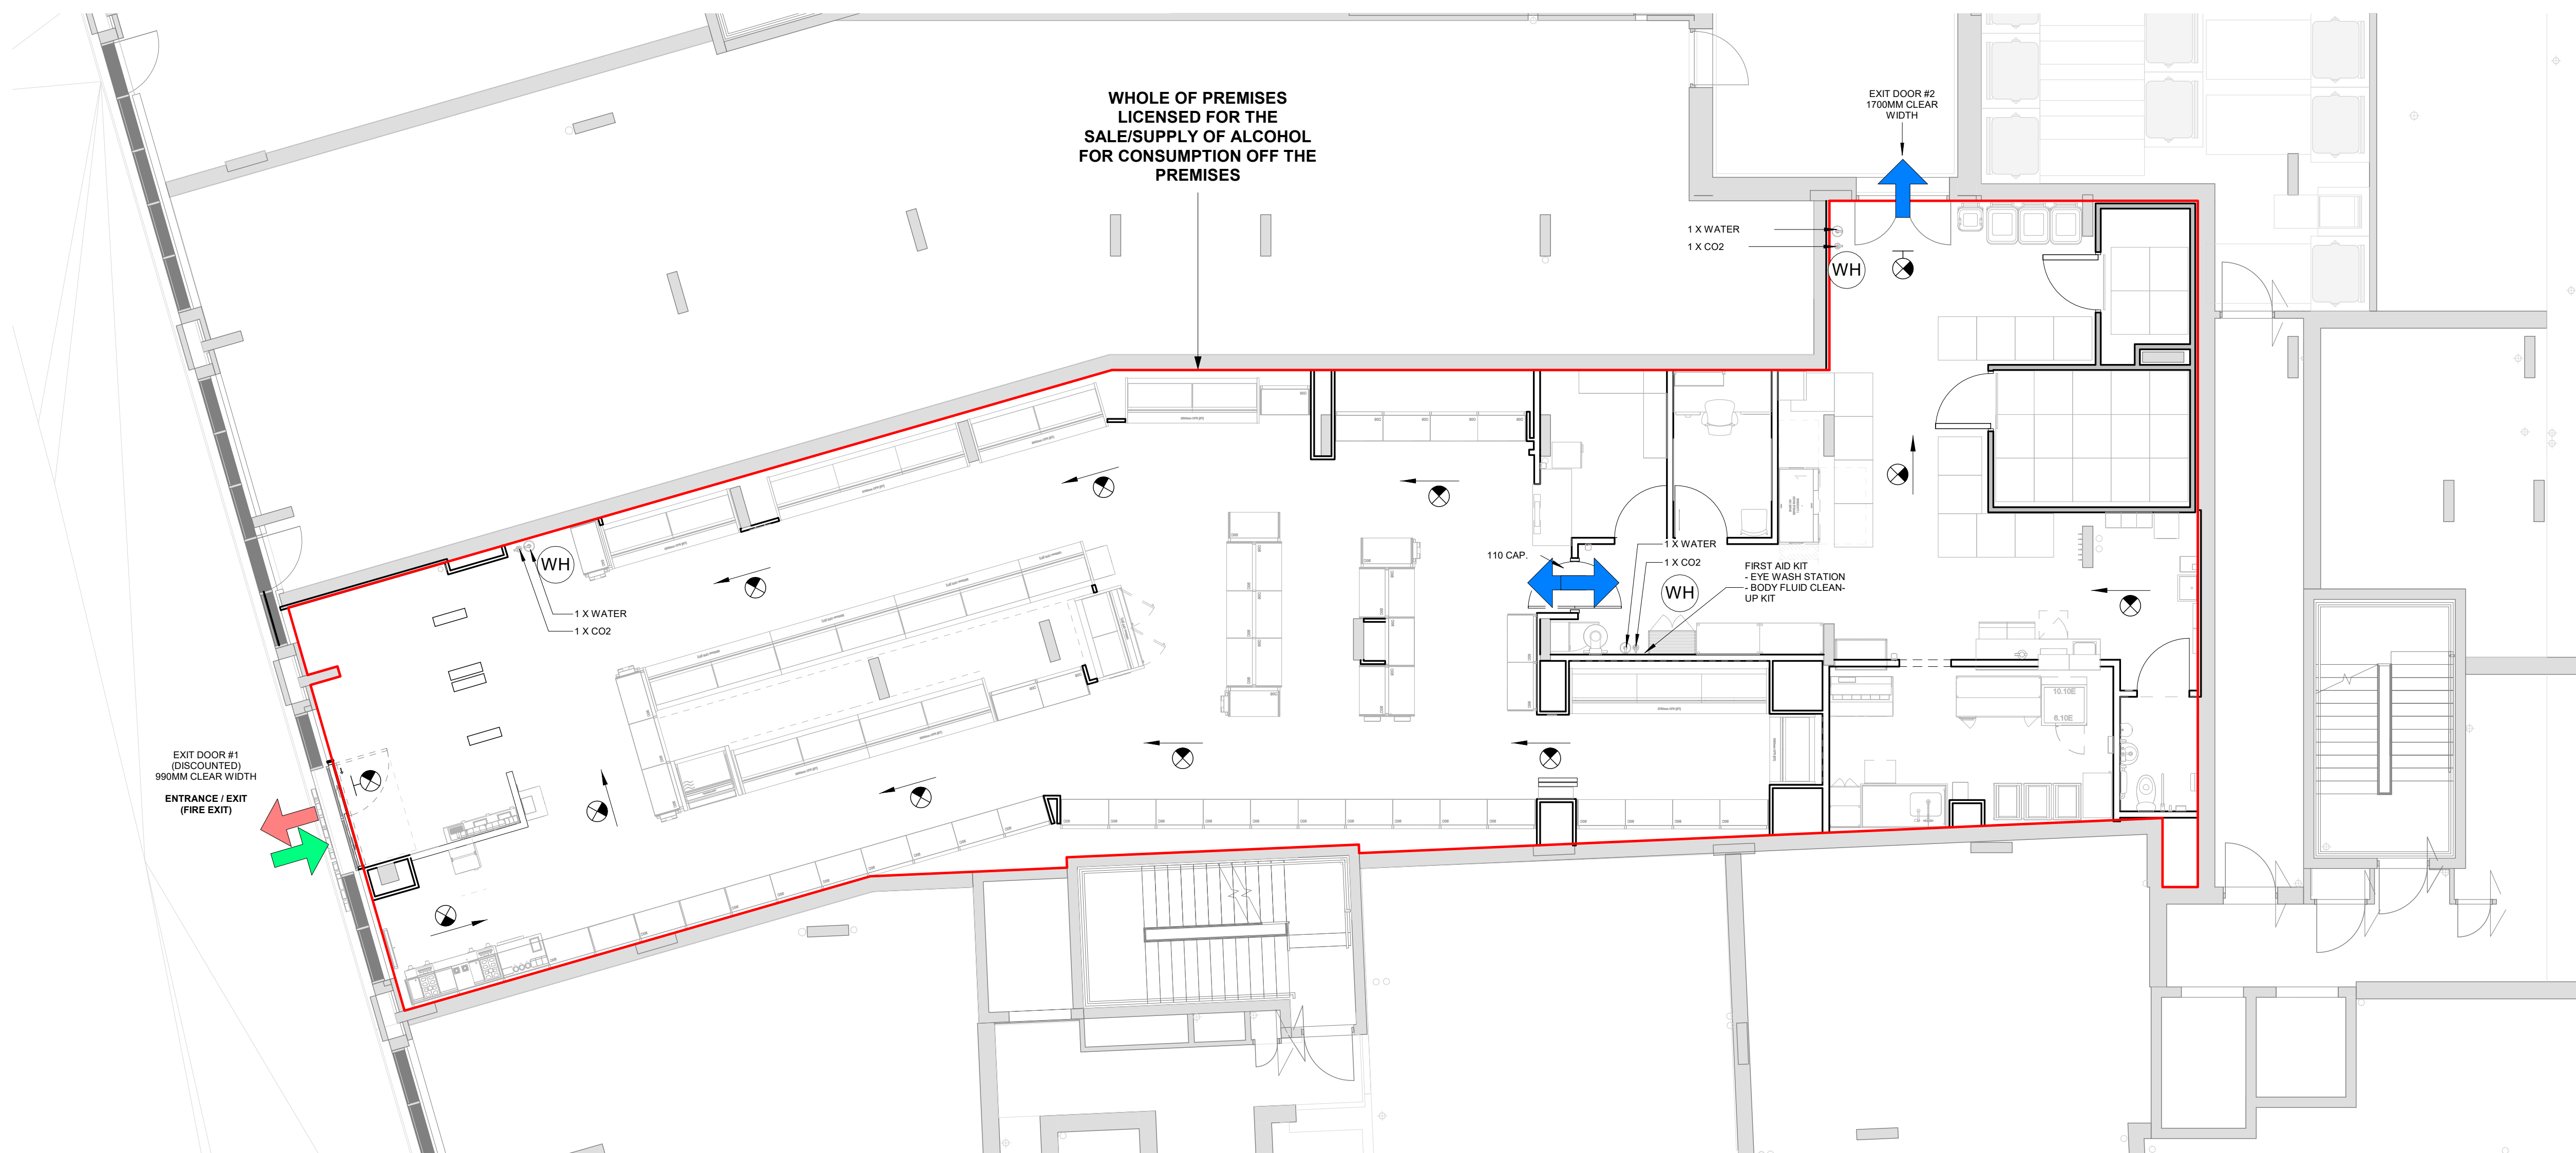

A4 LICENSING PLAN
1: 75

21/10/2022 10:03:54