

# RESULTS OF A DOUBLE 24-HOUR NOISE LEVEL SURVEY CARRIED OUT AT THE FRONT AND AT THE REAR OF THE RESIDENTIAL PROPERTY LOCATED AT NO 7 THE GROVE, LONDON N6

#### AND A REPORT ON THE NOISE IMPACT OF THE PROPOSED NEW EXTERNAL PLANT

Test Engineer : M G Roberts

Report Author : M G Roberts

Authorised for

Release by : I J Marchant

Client : The Watts Group
Project : 7 The Grove, London No
Emtec Ref. : QF10675/PF7130/RP1
Issue Date : 4<sup>th</sup> April 2022 : 7 The Grove, London N6





# RESULTS OF A DOUBLE 24-HOUR NOISE LEVEL SURVEY CARRIED OUT AT THE FRONT AND AT THE REAR OF THE RESIDENTIAL PROPERTY LOCATED AT NO 7 THE GROVE, LONDON N6

#### AND A REPORT ON THE NOISE IMPACT OF THE PROPOSED NEW EXTERNAL PLANT

#### 1.0. <u>INTRODUCTION</u>

This report details the results of two 24-hour noise surveys carried out at the front and at the rear of the residential house located at No 7 The Grove in Highgate, London N6. The two surveys were carried out concurrently, over the same 24-hour period.

The locations of the microphones were as follows,

- Location A At the front of the house on the first floor balcony
- Location B At the rear of the house in the centre of the back garden

The objectives of the survey were as follows:

- To assess the proposal to install new mechanical plant adjacent to the building.
- To identify the nearest residential properties that might be affected by noise from the new plant.
- To establish the existing background noise level outside the nearest affected properties.
- To recommend noise limits to ensure that the operation of the new plant does not disturb the occupants of the nearest affected properties and meets the planning directives of the local authority with regard to noise.

This report has been divided into the following sections for ease of analysis:

- 1.0. INTRODUCTION
- 2.0. SITE DESCRIPTION
- 3.0. TEST INSTRUMENTATION
- 4.0. TEST PROCEDURE
- 5.0. RESULTS AND EVALUATION OF NOISE CRITERIA
- 6.0. DISCUSSION OF RESULTS

#### 2.0. SITE DESCRIPTION

The property at No 7 The Grove is a semi-detached, four storey residential house located on the top of Highgate Hill in a very quiet residential area. The front of the building is shown on the attached Photo A and there is an adjacent residential property to the right which is also a four storey property and forms the other half of the building. On the left there is a flat on two floors which is designated as No 7A The Grove and takes up the left hand first and second floor areas of No 7. The residents of this property have no access to the rear garden. The Photo C indicates the property at No 7A.

To the rear of the building is a substantial garden and a further residential property is located at the bottom of this garden. This property is in Highfields Grove. The layout of the garden and the adjacent properties can be seen in the attached aerial view Photo F.

#### 3.0. <u>TEST INSTRUMENTATION</u>

All measurement equipment used during the survey complied with the requirements of BS4142:2014 "Method for Rating Industrial Noise Affecting Mixed Residential and Industrial Areas". Details of the equipment are as follows:

Integrating Sound Level Meter: Rion type NL-52 class 1 Sound Level Meters fitted with Rion type UC-59 ½ inch condenser microphones. Serial No 01232570 & 01121378

Statistical Analysis Modules: Built in module capable of computing the percentile levels LA<sub>1</sub>, LA<sub>10</sub>,

 $LA_{50}$ ,  $LA_{90}$  and  $LA_{99}$  and also the  $LA_{eq}$  level.

Acoustic Calibrator: Bruel & Kjaer type 4231 electronic calibrator. Serial No 1934160

Calibration was performed before and after the survey and was +/- 0.1 dB from the reference source.

#### 3.1. Existing Noise Climate

Road traffic travelling on surrounding roads could be heard at the start and end of the survey, so the noise levels measured will include contributions from road vehicles.

Commercial jet aircraft were observed at medium and high altitude during the manned periods at the start and the end of the survey, so it is possible that the noise levels measured could include contributions from medium altitude jet aircraft.

There are no overland railways nearby, so the noise levels measured will not include contributions from rail noise.

Construction works were not observed being carried out in the vicinity during the manned periods at the start and end of the survey so the sound levels recorded should be typical of normal daytime background noise levels.

#### 4.0. TEST PROCEDURE

The survey was conducted during a continuous 24-hour period from 10:31 am on Tuesday the 8th of March 2022 to 10:41 am on Wednesday the 9th of March 2022.

Data was continuously acquired throughout the measurement period with the individual averaging time for statistical noise data set to 15 minutes. The following 'A' weighted statistical measurements were recorded concurrently: -

- LA<sub>1</sub> The Sound Pressure Level exceeded for 1% of the measurement period.
- LA<sub>10</sub> The Sound Pressure Level exceeded for 10% of the measurement period.
- LA<sub>50</sub> The Sound Pressure Level exceeded for 50% of the measurement period.
- LA<sub>90</sub> The Sound Pressure Level exceeded for 90% of the measurement period. LA<sub>90</sub> is considered to represent the "background noise level" during the measurement period and is used for the assessment of noise to determine the likelihood of complaints (See BS 4142:2014).
- LA<sub>99</sub> The Sound Pressure Level exceeded for 99% of the measurement period.
- $\mathsf{LA}_\mathsf{eq}$  The continuous steady state Sound Pressure Level that has the same acoustic energy as the real fluctuating level.

#### 4.1. Measurement Positions

The microphones were mounted onto tripods and positioned approximately in the centre of the first floor balcony and in the centre of the back garden. The microphones were both oriented vertically and were approximately 1.5m above the level of the first floor and the back garden ground level. The locations of the microphones can be seen on the attached Photos A, D and F.

Location A - At the front of the house on the first floor balcony Location B - At the rear of the house in the centre of the back garden

Both of the microphones were connected by low impedance cables to their associated instrumentation which was contained within individual weatherproof housings.

#### 4.2 Weather Conditions

The weather conditions prevailing during the measurement period were in line with those recommended in BS 4142:2014: -

Weather daytime: - Clear Weather night time: - Clear Wind daytime: - Calm Wind night time: - Calm

The microphones were protected during the survey by acoustically transparent wind balloons.

#### 5.0. RESULTS AND EVALUATION OF NOISE CRITERIA

The raw test data, gathered during the noise survey, is given in Appendix 'A 'of this report.

The 'A' Weighted  $L_{\rm eq}$  levels measured over each 15 minute interval throughout the 24-hour period, denoted by  $LA_{\rm eq}$ , (15 mins), are displayed as bar graphs on the attached Sketches No QF/10675/T1 and -/T3 at the back of this report.

The 'A' Weighted percentile levels measured over each 15 minute interval throughout the 24-hour period, denoted by  $LA_{10}$  (15 mins),  $LA_{50}$  (15 mins) and  $LA_{90}$  (15 mins) are displayed as line graphs on the attached Sketches No QF/10675/T2 and -/T4 at the back of this report.

#### 5.1. Summary of Results

The table QF/10675/D1 below summarises the noise levels taken over the 24-hour period in terms of the maximum and minimum Sound Pressure Levels recorded.

Table OF/ 106/5/DT - Summary of Maximum and Minimum Noise Lev	575/D1 – Summary of Maximum and Mir	nimum Noise Levels
---	-------------------------------------	--------------------

	Location	$LA_{eq}$	LA <sub>1</sub>	LA <sub>10</sub>	LA <sub>50</sub>	LA <sub>90</sub>	LA <sub>99</sub>
N.4.	А	41dBA	48dBA	40dBA	34dBA	32dBA	31dBA
Minimum	В	30dBA	33dBA	31dBA	30dBA	29dBA	28dBA
Maximum	Α	66dBA	74dBA	72dBA	60dBA	54dBA	54dBA
Maximum	В	57dBA	72dBA	56dBA	47dBA	42dBA	40dBA

The table QF/10675/D2 below states the minimum  $LA_{90}$  noise levels recorded during the time periods of 7.00am to 23.00pm ( Daytime / Evening ) and 23.00pm and 7.00am ( Night time )

Table QF/10675/D2 - Minimum LA90 Noise Levels - Daytime/Evening and Night time

	Location	Minimum LA <sub>90</sub>
Doutime/Evening ( 7cm to 11nm )	Α	41dBA
Daytime/Evening ( 7am to 11pm )	В	35dBA
Night Time (11pm to 7cm)	Α	32dBA
Night Time ( 11pm to 7am )	В	29dBA

# 5.2. <u>Summary of the Local Authority's planning requirements regarding noise for noise sensitive properties</u>

The local planning authority is the London Borough of Camden.

The Camden Local Plan sets out the Council's planning policies and replaces the Core Strategy and Development Policy planning documents (adopted in 2010). It ensures that Camden continues to have robust, effective and up-to-date planning policies that respond to changing circumstances and the borough's unique characteristics and contribute to delivering the Camden Plan and other local priorities.

The Local Plan will cover the period from 2016-2031. Policy A4 of The Local Plan is entitled Noise and Vibration and states:

The Council will seek to ensure that noise and vibration is controlled and managed. Development should have regard to Camden's Noise and Vibration thresholds (Appendix 3). We will not grant planning permission for a) a development likely to generate unacceptable noise and vibration impacts or b) a development sensitive to noise in locations which experience high levels of noise, unless appropriate attenuation measures can be provided and will not harm the continued operation of existing uses. We will only grant permission for noise generating development, including any plant and machinery, if it can be operated without causing harm to amenity. We will also seek to minimise the impact on local amenity from deliveries and from the demolition and construction phases of development.

The parts of Appendix 3 that we have identified as relevant to this application are as follows:

#### Appendix 3: Noise thresholds

The significance of noise impact varies dependent on the different noise sources, receptors and times of operation presented for consideration within a planning application. Therefore, Camden's thresholds for noise and vibration evaluate noise impact in terms of various 'effect levels' described in the National Planning Policy Framework and Planning Practice Guidance:

- NOEL No Observed Effect Level
- LOAEL Lowest Observed Adverse Effect Level
- SOAEL Significant Observed Adverse Effect Level

Three basic design criteria have been set for proposed developments, these being aimed at guiding applicants as to the degree of detailed consideration needed to be given to noise in any planning application. The design criteria outlined below are defined in the corresponding noise tables. The values will vary depending on the context, type of noise and sensitivity of the receptor:

- Green where noise is considered to be at an acceptable level.
- Amber where noise is observed to have an adverse effect level, but which may be considered acceptable when assessed in the context of other merits of the development.
- Red where noise is observed to have a significant adverse effect.

Table C: Noise levels applicable to proposed industrial and commercial developments (including plant and machinery)

Existing Noise sensitive receptor	Assessment Location	Design Period	LOAEL (Green)	LOAEL to SOAEL (Amber)	SOAL (Red)
Dwellings**	Garden used for main amenity (free field) and ellings** Outside living or dining or bedroom window (façade)		'Rating level' 10dB* below background	'Rating level' between 9dB below and 5dB above background	'Rating level' greater than 5dB above background
Dwellings**	Outside bedroom window (façade)	Night	'Rating level' 10dB* below background and no events exceeding 57dBL <sub>Amax</sub>	'Rating level' between 9dB below and 5dB above background or noise events between 57dB and 88dB L <sub>Amax</sub>	'Rating level' greater than 5dB above background and/or events exceeding 88dB L <sub>Amax</sub>

<sup>\*10</sup>dB should be increased to 15dB if the noise contains audible tonal elements (day and night). However, if it can be demonstrated that there is no significant difference in the character of the residual background noise and the specific noise from the proposed development then this reduction may not be required. In addition, a frequency analysis (to include, the use of Noise Rating (NR) curves or other criteria curves) for the assessment of tonal or low frequency noise may be required.

The periods in Table C correspond to 0700 hours to 2300 hours for the day and 2300 hours to 0700 hours for the night. The Council will take into account the likely times of occupation for types of development and will be amended according to the times of operation of the establishment under consideration.

There are certain smaller pieces of equipment on commercial premises, such as extract ventilation, air conditioning units and condensers, where achievement of the rating levels (ordinarily determined by a BS:4142 assessment) may not afford the necessary protection. In these cases, the Council will generally also require an NR curve specification of NR35 or below, dependant on the room (based upon measured or predicted  $L_{\rm eq}$  (5mins) noise levels in octave bands, 1 metre from the façade of affected premises, where the noise sensitive premise is located in a quiet background area.

<sup>\*\*</sup>levels given are for dwellings, however, levels are use specific and different levels will apply dependent on the use of the premises.

#### 5.3. <u>Determination of noise sensitive property design criteria</u>

We believe that the sound produced by the new plant will not be intermittent or contain tones. To comply with a green rating from the table above the new plant should therefore have a Sound Pressure Level 10dB below the lowest  $LA_{90}$  background noise level at 1 metre from the nearest noise sensitive window.

The lowest recorded LA<sub>90</sub> background noise levels measured during the 24 hour survey period are given in Table QF/10675/D2 above.

Applying the above criteria gives limiting rating levels as listed in table QF/10675/D3 below:

Table QF/10675/D3 - Proposed Design Rating Levels (LAeq)

Existing Noise sensitive receptor	Design Period	Location	Lowest measured background level	Proposed rating level	Proposed Local Authority criteria
	Day	Α	41 <i>dBA</i>	31dBA	Green
Dwellings -	Day	В	35dBA	25dBA	Green
Dwellings	Night	Α	32dBA	22dBA	Green
	ivigiit	В	29dBA	19dBA	Green

#### 5.5. <u>Summary of external noise criteria</u>

Based upon the lowest measured  $LA_{90}$  background noise levels during the survey and the Council's requirements outlined above we summarise the design rating levels to be adopted for this project in table QF/10675/D4: -

Table QF/10675/D4 - recommended design rating levels LAr, T


Type of premises	Location	L <sub>Ar,T</sub> (7am - 11pm)	L <sub>Ar,T</sub> (11pm - 7am)
Noise consitive	A - front of house	31dBA	22dBA
Noise sensitive	B - rear of house	25dBA	19dBA

#### 6.0. <u>DISCUSSION OF RESULTS</u>

It is proposed to install heat pump condensers and possibly ventilation plant with external louvres either in the front or rear of the house.

The new plant should be selected and attenuated, if necessary, in order for the new equipment or systems to have a noise level no greater than the recommended design rating levels listed in Table QF/10675/D4 during the normal operational times of the plant. These noise levels should apply at a position 1 metre from the nearest neighbouring noise sensitive window.

Emtec Products Ltd 4<sup>th</sup> April 2022

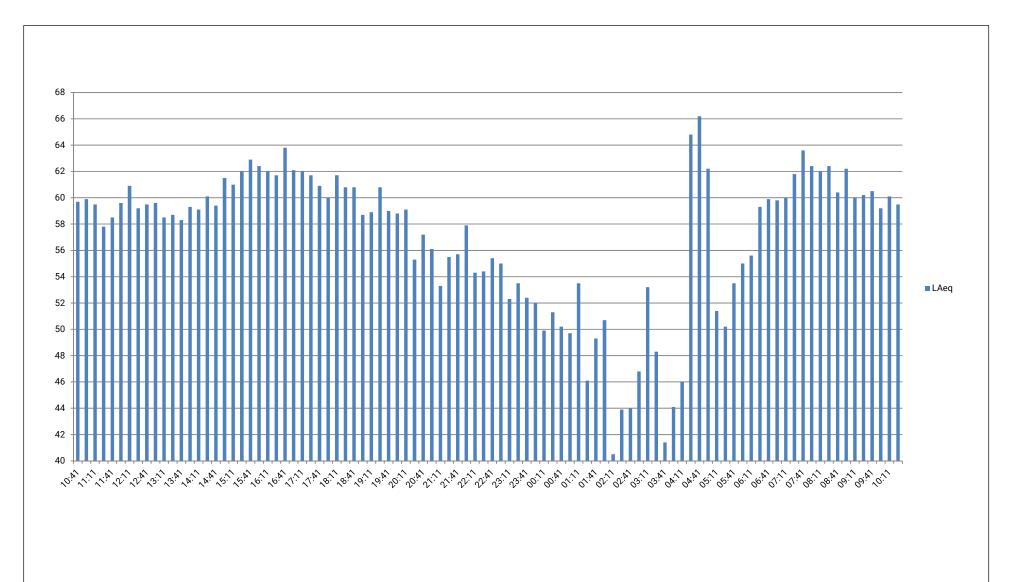

TITLE: LAeq Levels (Location A - front 1 <sup>st</sup> floor balcony)			ISSUE DATE: 12th March 2022			DRAWN BY: MGR	Α	В	С	D	Ε	F	G	Н
CLIENT:	The Watts Group	PF No: 7130 APPROVED BY: REVISION MGR				V								
PROJECT:	7 The Grove, London N6	Q	Α	М	I	DESIGN AUTH: MGR					675/	′T1		




Unit L, Turnpike Way, High Wycombe, Buckinghamshire, HP12 3TF Telephone: 020 8848 3031 www.emtecproducts.co.uk



TITLE: LA10; LA50 & LA90 Levels (Location A - front)		ISSUE DATE: 12th March 2022			DRAWN BY: MGR	Α	В	С	D	Ε	F	G	Н
CLIENT: The Watts Group	PF	No: 7	7130		APPROVED BY: MGR			F	REVI	SION	V		
PROJECT: 7 The Grove, London N6	Q	Α	М	1	DESIGN AUTH: MGR	SKETCH No. QF/10675/T2			T2				




Unit L, Turnpike Way, High Wycombe, Buckinghamshire, HP12 3TF Telephone: 020 8848 3031 www.emtecproducts.co.uk

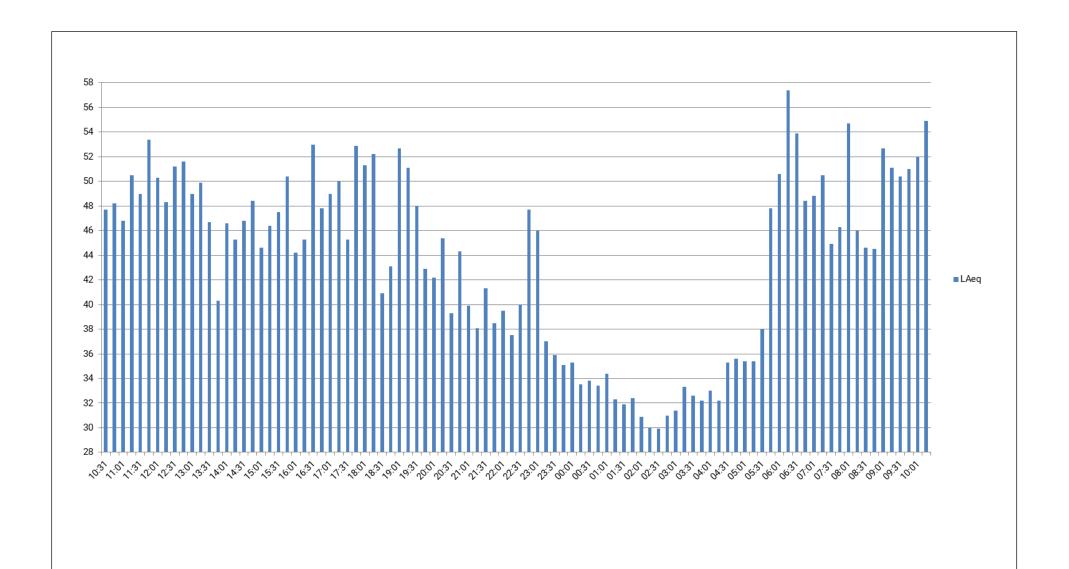

TITLE:  LAeq Levels ( Location B - rear garden )		UE D <i>i</i> h Mai	ATE: rch 20	022	DRAWN BY: MGR	Α	В	С	D	Ε	F	G	Н
CLIENT: The Watts Group	PF	No: 7	7130		APPROVED BY: MGR		•	F	REVI	SION	I		
PROJECT: 7 The Grove, London N6	Q	Α	М	I	DESIGN AUTH: MGR	SK	ETCI	H No	o. QF	/10	675/	Т3	



Unit L, Turnpike Way, High Wycombe, Buckinghamshire, HP12 3TF Telephone: 020 8848 3031 www.emtecproducts.co.uk

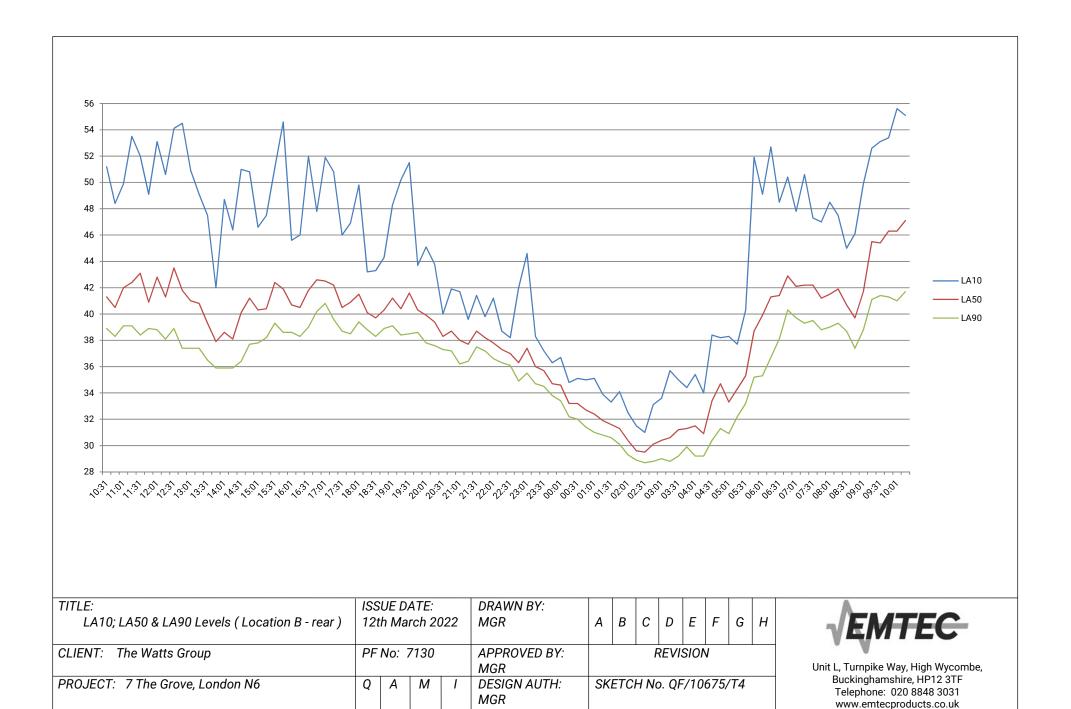

## APPENDIX 'A'

Raw Data – Noise Survey 8th of March 2022 to 9th of March 2022

7 The Grove, London N6 ( Location A -front of house on first floor balcony ) The Watts Group  $\,$ 

Project: Client: 8th to 9th March 2022 Date:

01232570 Serial No:

Address	Start Time	<b>LA</b> <sub>eq</sub>	LE	Lmax	Lmin	LA <sub>1</sub>	<b>LA</b> <sub>10</sub>	<b>LA</b> <sub>50</sub>	<b>LA</b> <sub>90</sub>	<b>LA</b> 99
1	10:41	60	89	74	44	66	63	56	51	<b>4</b> 9
2	10:41	60	90	80	46	65	63	56	52	51
3	11:11	60	89	78	45	66	63	56	52	50
4	11:26	58	87	70	44	63	61	55	49	48
5	11:41	59	88	70	46	64	62	55	50	49
6	11:56	60	89	75	47	65	63	57	52	51
7	12:11	61		73	44	66	65	58	52	50
	12:11	59	91	72		65	63	56	52	51
8 9	12:20	60	89 89	77	46 46	65	62	55	51	50
10		60		73	45	66	63	56	52	51
11	12:56	59	89	70	46	64			51	50
12	13:11 13:26	59	88 88	70	45	64	63 62	56 56	51	50
					45					
13	13:41	58	88	78		64	62	55	51	49
14	13:56	59	89	75 75	45	65	64	55	50	48
15	14:11	59	89	75	43	65	63	54	50	48
16	14:26	60	90	73	45	66	64	57	51	49
17	14:41	59	89	71	45	65	63	56	51	49
18	14:56	62	91	78	45	68	65	57	50	49
19	15:11	61	91	74	47	67	65	58	53	52
20	15:26	62	92	79	47	68	66	57	51	50
21	15:41	63	93	78	48	68	67	60	52	51
22	15:56	62	92	76	47	68	67	59	52	51
23	16:11	62	92	73	45	68	66	58	52	51
24	16:26	62	91	79	47	68	66	57	51	50
25	16:41	64	93	79	46	69	67	60	52	50
26	16:56	62	92	77	44	68	66	58	51	49
27	17:11	62	92	74	46	68	66	59	51	49
28	17:26	62	91	74	47	68	66	57	51	50
29	17:41	61	91	76	45	67	65	57	51	50
30	17:56	60	90	73	46	67	65	55	51	49
31	18:11	62	91	78	46	68	66	57	51	49
32	18:26	61	90	76	44	67	65	56	50	49
33	18:41	61	90	72	46	67	65	57	51	50
34	18:56	59	88	73	44	65	62	55	50	49
35	19:11	59	89	79	46	65	63	55	51	50
36	19:26	61	90	78	43	67	64	56	50	48
37	19:41	59	89	75	43	65	62	55	49	47
38	19:56	59	88	72	43	65	63	55	48	47
39	20:11	59	89	82	42	65	62	53	46	44
40	20:26	55	85	76	41	61	58	51	45	44
41	20:41	57	87	73	41	64	61	51	44	43
42	20:56	56	86	72	40	63	60	51	44	43
43	21:11	53	83	72	40	58	56	50	43	42
44	21:26	56	85	71	40	61	58	52	44	43
45	21:41	56	85	71	40	62	59	51	44	43
46	21:56	58	88	81	39	62	59	51	43	42
47	22:11	54	84	71	39	60	57	50	43	42
48	22:26	54	84	71	38	59	57	49	42	41
49	22:41	55	85	71	36	62	59	50	41	40

# QF10675/PF7130/RP1

# EMTEC PRODUCTS LTD.

50	22:56	55	85	69	37	61	58	50	41	40
51	23:11	52	82	68	36	58	57	47	38	38
52	23:26	54	83	73	35	58	56	48	38	37
53	23:41	52	82	69	35	57	55	44	37	36
54	23:56	52	82	74	34	56	54	43	36	36
55	00:11	50	80	68	33	56	54	39	35	35
56	00:26	51	81	71	33	56	53	40	35	35
57	00:41	50	80	73	33	54	52	38	35	35
58	00:56	50	79	68	34	56	53	40	36	35
59	01:11	54	83	79	33	54	51	38	34	34
60	01:26	46	76	61	32	53	51	37	34	33
61	01:41	49	79	67	32	56	53	39	34	33
62	01:56	51	80	75	31	54	51	37	33	32
63	02:11	41	70	57	30	48	40	34	32	32
64	02:26	44	74	61	31	52	47	35	33	32
65	02:41	44	74	65	31	50	46	36	33	33
66	02:56	47	76	63	30	54	51	37	33	32
67	03:11	53	83	76	30	55	49	37	33	32
68	03:26	48	78	71	30	52	48	37	32	32
69	03:41	41	71	57	30	49	45	35	32	31
70	03:56	44	74	59	31	52	49	37	33	32
71	04:11	46	76	66	31	51	47	36	33	32
72	04:26	65	94	81	31	73	70	46	35	34
73	04:41	66	96	81	32	74	72	45	36	35
74	04:56	62	92	80	31	71	62	40	34	33
75	05:11	51	81	72	33	55	53	42	36	35
76	05:26	50	80	67	34	56	54	43	37	36
77	05:41	54	83	73	34	58	56	46	39	38
78	05:56	55	85	73	35	60	57	47	38	37
79	06:11	56	85	72	36	62	59	51	43	41
80	06:26	59	89	78	39	64	61	54	45	43
81	06:41	60	90	80	41	66	64	56	49	47
82	06:56	60	89	79	43	66	64	57	51	50
83	07:11	60	90	75	47	66	64	57	53	52
84 85	07:26	62	91 93	79 90	47	67	65 67	58	54	53
	07:41	64	_	80	49	69	67	60	54	54
86	07:56	62	92	79	47	68	67	59	53	52
87	08:11	62	92	74 75	48	67	66	59	53	52 52
88	08:26	62	92	75	50	68	66	60	54	53
89	08:41 08:56	60	90	74	43	66	64	56 50	50	49 51
90		62	92	78 70	45 47	68 65	66	58 57	53	51 51
91	09:11	60	90	70		65	64	57	52 52	
92	09:26 09:41	60	90	76 72	46 45	66	64	56 57	52 52	51 51
93	09:41	61	90	72 72	45	66	65	57 55	52	51
94		59	89	73	44	66	63	55	49	48
95	10:11	60	90	75 74	43	67 65	64	56 56	50	49 50
96	10:26	60	89	74	43	65	64	56	52	50

7 The Grove, London N6 (Location B - in rear garden) The Watts Group 8th to 9th March 2022

Project: Client: Date:

01121378 Serial No.:

Address	Start Time	<b>LA</b> <sub>eq</sub>	LE	Lmax	Lmin	LA <sub>1</sub>	<b>LA</b> <sub>10</sub>	<b>LA</b> <sub>50</sub>	<b>LA</b> <sub>90</sub>	<b>LA</b> 99
1	10:31	48	77	64	36	59	51	41	39	38
2	10:31	48	78	76	37	59	48	41	38	37
3	11:01	47	76	65	37	58	50	42	39	38
4	11:16	51	80	70	37	63	54	42	39	38
5	11:31	49	79	67	36	61	52	43	38	37
6	11:46	53	83	74	37	68	49	41	39	38
7	12:01	50	80	68	37	62	53	43	39	38
8	12:16	48	78	67	36	60	51	41	38	37
9	12:31	51	81	68	36	63	54	44	39	37
10	12:46	52	81	70	35	64	55	42	37	36
11	13:01	49	79	70	36	62	51	41	37	36
12	13:16	50	80	69	35	64	49	41	37	36
13	13:31	47	76	68	34	59	48	39	37	35
14	13:46	40	70	57	34	51	42	38	36	35
15	14:01	47	76	69	34	59	49	39	36	35
16	14:16	45	75	62	34	58	46	38	36	35
17	14:31	47	76	63	34	58	51	40	36	35
18	14:46	48	78	67	35	61	51	41	38	36
19	15:01	45	74	62	36	56	47	40	38	37
20	15:16	46	76	68	35	59	48	40	38	37
21	15:31	48	77	64	35	58	51	42	39	37
22	15:46	50	80	67	36	62	55	42	39	37
23	16:01	44	74	64	36	55	46	41	39	37
24	16:16	45	75	72	36	55	46	41	38	37
25	16:31	53	83	75	37	67	52	42	39	38
26	16:46	48	77	69	37	60	48	43	40	38
27	17:01	49	79	70	39	61	52	43	41	40
28	17:16	50	80	71	37	63	51	42	40	38
29	17:31	45	75	65	37	57	46	41	39	38
30	17:46	53	83	74	37	68	47	41	39	38
31	18:01	51	81	72	37	65	50	42	39	38
32	18:16	52	82	78	37	67	43	40	39	38
33	18:31	41	71	51	37	47	43	40	38	38
34	18:46	43	73	70	37	50	44	40	39	38
35	19:01	53	82	83	37	57	48	41	39	38
36	19:16	51	81	75	36	65	50	40	38	37
37	19:31	48	78	66	36	59	52	42	39	37
38	19:46	43	73	60	37	54	44	40	39	38
39	20:01	42	72	57	36	51	45	40	38	37
40	20:16	45	75	63	36	59	44	39	38	36
41	20:31	39	69	61	36	43	40	38	37	37
42	20:46	44	74	63	34	57	42	39	37	36
43	21:01	40	70	59	35	47	42	38	36	35
44	21:16	38	68	49	35	42	40	38	36	36
45	21:31	41	71	58	36	53	41	39	38	37
46	21:46	39	68	48	36	42	40	38	37	36
47	22:01	40	69	54	35	48	41	38	37	36
48	22:16	38	67	47	35	41	39	37	36	36
49	22:31	40	70	66	35	41	38	37	36	36

# QF10675/PF7130/RP1

# EMTEC PRODUCTS LTD.

50	22:46	48	77	69	33	63	42	36	35	34
51	23:01	46	76	65	34	59	45	37	36	35
52	23:16	37	67	51	33	44	38	36	35	34
53	23:31	36	66	44	33	40	37	36	35	34
54	23:46	35	65	42	32	40	36	35	34	33
55	00:01	35	65	46	32	42	37	35	33	33
56	00:16	34	63	46	31	38	35	33	32	32
57	00:31	34	63	45	31	40	35	33	32	31
58	00:46	33	63	44	30	39	35	33	31	31
59	01:01	34	64	53	30	45	35	32	31	30
60	01:16	32	62	39	30	36	34	32	31	30
61	01:31	32	62	43	29	35	33	32	31	30
62	01:46	32	62	46	29	38	34	31	30	29
63	02:01	31	61	43	28	35	33	30	29	29
64		30		39	28	33	32		29	29
65	02:16 02:31	30	60 60	38	28	35	31	30 30	29	28
66		31	61	38 46	27	36	33	30	29	28
	02:46								29	
67	03:01	31	61	43	27	37	34	30		28
68	03:16	33	63	50	28	43	36	31	29	28
69	03:31	33	62	48	27	40	35	31	29	28
70	03:46	32	62	46	28	38	34	31	30	29
71	04:01	33	63	44	28	40	35	32	29	28
72	04:16	32	62	46	28	40	34	31	29	29
73	04:31	35	65	49	29	43	38	33	30	30
74	04:46	36	65	45	29	42	38	35	31	30
75	05:01	35	65	53	30	44	38	33	31	30
76	05:16	35	65	48	30	42	38	34	32	31
77	05:31	38	68	52	31	48	40	35	33	32
78	05:46	48	77	65	32	60	52	39	35	34
79	06:01	51	80	74	32	64	49	40	35	34
80	06:16	57	87	81	33	72	53	41	37	35
81	06:31	54	84	77	35	69	49	41	38	36
82	06:46	48	78	70	37	59	50	43	40	38
83	07:01	49	78	73	37	61	48	42	40	38
84	07:16	51	80	72	36	63	51	42	39	38
85	07:31	45	75	70	37	54	47	42	40	38
86	07:46	46	76	67	37	58	47	41	39	38
87	08:01	55	84	76	37	70	49	42	39	38
88	08:16	46	76	64	37	58	48	42	39	38
89	08:31	45	74	66	36	56	45	41	39	37
90	08:46	45	74	63	35	57	46	40	37	36
91	09:01	53	82	74	36	67	50	42	39	37
92	09:16	51	81	72	37	64	53	46	41	39
93	09:31	50	80	70	38	61	53	45	41	39
94	09:46	51	81	72	37	62	53	46	41	39
95	10:01	52	82	73	36	63	56	46	41	38
96	10:16	55	85	76	37	69	55	47	42	39
				·			·	·		1

# QF10675/PF7130/RP1

# EMTEC PRODUCTS LTD.

## APPENDIX 'B'

**Photos and Drawing** 

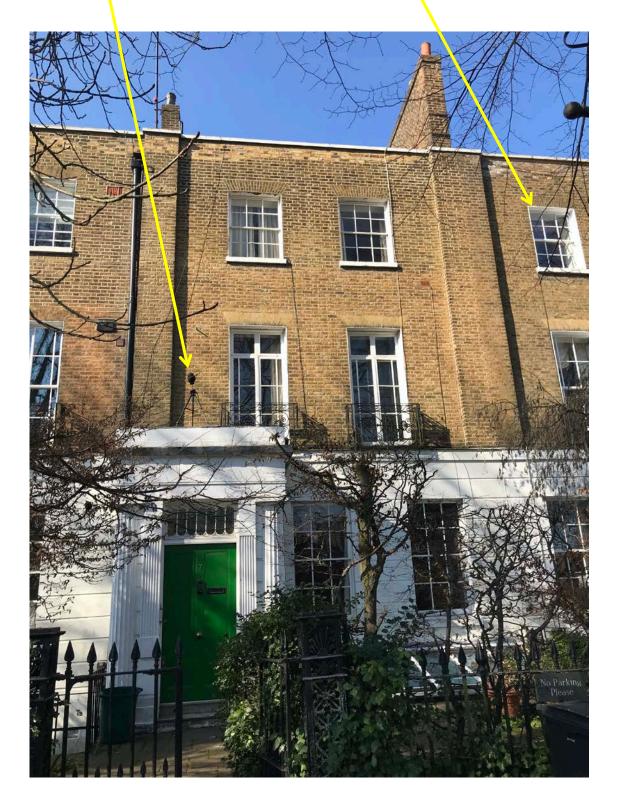


PHOTO A - Front of No7, The Grove with microphone on the first floor balcony



PHOTO B - Neighbouring residential property at 8 The Grove

Windows of neighbouring property at 7A The Grove

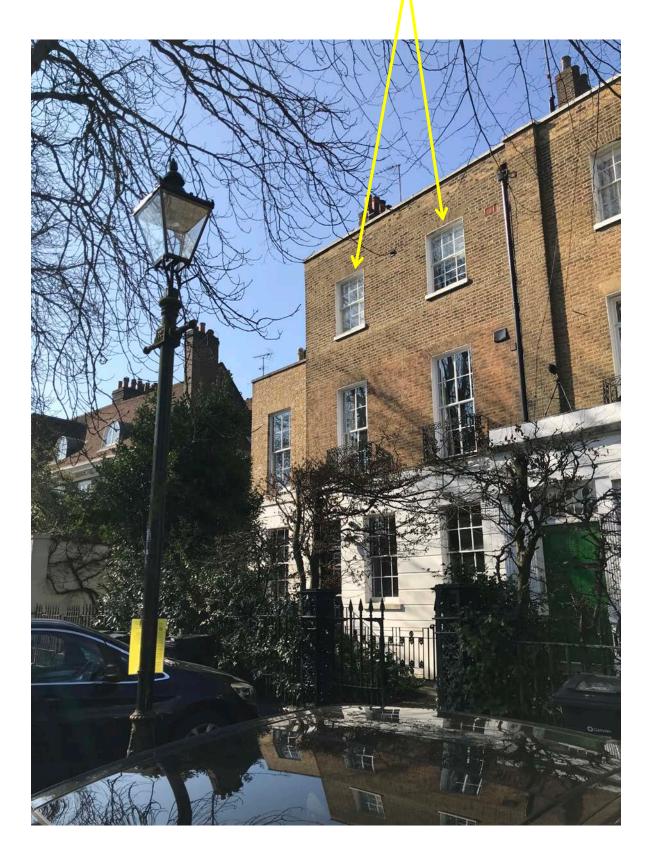


PHOTO C - Next door neighbouring residential property at 7A The Grove

Microphone location B



PHOTO D - Rear of No 7 The Grove with microphone in the back garden

# Windows of neighbouring house in Highfields Grove



PHOTO E - Residential property, in Highfields Grove, over the boundary wall at the bottom of the back garden



Neighbouring property in Highfields Grove

PHOTO F - Aerial view of the property at No 7 The Grove with microphone locations at front and rear