


NOTES

1. This drawing is for engineering services only and is to be read in conjunction with all relevant architectural, structural, mtt drawings and the Contract specification.
2. THIS IS NOT AN INSTALLATION DRAWING.
3. All services routes and equipment locations are indicative, actual location and configuration to be determined by contractor following completion of contractor design and coordination.
4. This drawing will only be issued in PDF format.
5. All sanitary fittings to be WRAS approved.
6. All terminal fittings shall be fitted with accessible combined constant flow regulators and servicing valves as Viega CP961 screwed wondervalve to be accessible.  
WC - 4 lpm Cold  
WHB - 4 lpm Hot and Cold  
SHW - 8 lpm Hot and Cold  
Bath - 12 lpm Hot and Cold  
Pipe Sizing  
Basins - 1LU  
WCS - 1LU  
Showers - 2LU
7. All access points and rodding eyes to be located behind readily accessible panels. Access doors on stacks to be typically at 1200mm AFRL. Exact location to suit builderswork access panels in Architectural finishes.
8. All penetrations of the fire compartment are to be suitable treated and sealed. All non-metallic pipework is to be provided with fire collars.
9. All pipework to be supported in accordance with the manufacturer's requirements.
10. Allowance shall be made for additional access points for testing.
11. Drainage offsets and base of stacks shall be made with long radius 90o bends or 2No 45o bends.
12. All Soil and rainwater pipes be provided with 25mm fall faced rock wool insulation.
13. All 75mm and 100mm Soil and waste pipework with flow rates less than 1 l/sec shall be installed to a fall of 1:40. All 75mm and 100mm Soil and waste pipework with flow rates greater than 1 l/sec shall be installed to a fall of 1:60 - 1:80.
14. All surface water drainage will be installed at falls of 1:100 for 100mm and 1:75 for 75mm unless otherwise noted.
15. Refer to drawing CGY-MTT-SW-DRG-P-0001 Public Health Services Legend of Symbols.

KEY PLAN

Copyright by mtt. No copies of this drawing, however produced and/or transmitted may be made or undertaken, without the express permission of mtt.					
This drawing should not be scaled. All dimensions to be checked on site. Any discrepancies to be notified to mtt.					
Issue control table: CGY08-MTT-ZZZ-B1-DR-P-2010 Date: 12/08/2022 CGY08-MTT-ZZZ-B1-DR-P-2010 Date: 11/05/2022 CGY08-MTT-ZZZ-B1-DR-P-2010 Date: 19/01/2022					
Rev.	Date	Description	Drawn	Checked	
P3	12/08/2022	Stage 4 Issue	NK	JM	
P2	11/05/2022	Stage 4 Issue: Comments Incorporated.	NK	JM	
P1	19/01/2022	Stage 4 Issue	NK	JM	

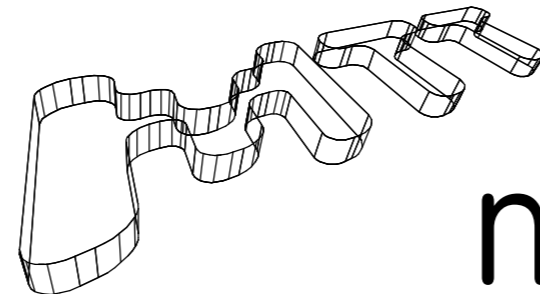

MTT/DRAWING

A 9 KINGSWAY LONDON WC2B 6AF T +44 (0)20 7836 1133 F +44 (0)20 7836 1153 E info@mtt-limited.com W mtt-limited.com		PM T Ward Csd N Keyser Date February 2022 Scale 1 : 50 @ A0 Status <b>STAGE 4</b>	Camden Goods Yard Public Health Services Building E - Level B1 Drainage Layout - Sheet 1 of 2 Dig No: CGY08-MTT-ZZZ-B1-DR-P-2010 Revision P3		
---	--	---	---	--	--